

The Town of Cobalt

# OPERATIONAL PLAN

*for the Cobalt Drinking Water System*

*Updated: July 8, 2024*



---

This Operational Plan is designed for the exclusive use of the system(s) specified in this Operational Plan.

This Operational Plan has been developed with OCWA's operating practices in mind and utilizing OCWA personnel to implement it.

Any use which a third party makes of this Operational Plan, or any part thereof, or any reliance on or decisions made based on information within it, is the responsibility of such third parties. OCWA accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions taken based on this Operational Plan or any part thereof.



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Doc: OP-ToC  
Issue Date: 2024-07-08  
Pages: 1 of 1

**TABLE OF CONTENTS**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

- OP-01** OCWA's Quality & Environmental Management System (QEMS)
- OP-02** Quality & Environmental Management System Policy
- OP-03** Commitment & Endorsement of OCWA's QEMS & Operational Plan
  - OP-03A** Signed Commitment and Endorsement
- OP-04** Quality Management System Representative
- OP-05** Document and Records Control
  - OP-05A** Document and Records Control Locations
- OP-06** Drinking Water System
  - OP-06A** Drinking Water System Description
- OP-07** Risk Assessment
- OP-08** Risk Assessment Outcomes
  - OP-08A** Summary of Risk Assessment Outcomes
- OP-09** Organizational Structure, Roles, Responsibilities & Authorities
  - OP-09A** Organizational Structure
- OP-10** Competencies
- OP-11** Personnel Coverage
- OP-12** Communications
- OP-13** Essential Supplies and Services
- OP-14** Review and Provision of Infrastructure
- OP-15** Infrastructure Maintenance, Rehabilitation and Renewal
- OP-16** Sampling, Testing and Monitoring
- OP-17** Measurement and Recording Equipment Calibration and Maintenance
- OP-18** Emergency Management
- OP-19** Internal QEMS Audits
- OP-20** Management Review
- OP-21** Continual Improvement

**Schedule "C"** Ministry's Director's Directions *Minimum Requirements for Operational Plans*



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-01  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 1 of 2

### QUALITY & ENVIRONMENTAL MANAGEMENT SYSTEM (QEMS)

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

## 1. Purpose

To document OCWA's Quality & Environmental Management System (QEMS). This Operational Plan defines and documents the QEMS for the Cobalt Drinking Water System operated by the Ontario Clean Water Agency (OCWA). It sets out OCWA's policies and procedures with respect to quality and environmental management in accordance with the requirements of the Province of Ontario's Drinking Water Quality Management Standard (DWQMS).

## 2. Definitions

*Drinking Water Quality Management Standard (DWQMS)* – has the same meaning as Quality Management Standard for Drinking Water Systems approved under section 21 of the Safe Drinking Water Act (SDWA).

*Operational Plan* – means the operational plan required by the Director's Direction.

*Quality & Environmental Management System (QEMS)* – a system to:

- a) Establish policy and objectives, and to achieve those objectives; and
- b) Direct and control an organization with regard to quality.

*Ministry* - means the Ontario government ministry responsible for the administration of the SDWA.

## 3. Procedure

3.1 The Cobalt Drinking Water System is owned by the Town of Cobalt. OCWA is the contracted Operating Authority for the Cobalt Drinking Water System, which includes the Cobalt Water Treatment Plant, Water Tower and the Cobalt Distribution System.

3.2 OCWA's Quality & Environmental Management System (QEMS) is structured and documented with the purpose of:

1. Establishing policy and objectives with respect to the effective management and operation of water/wastewater facilities;
2. Understanding and controlling the risks associated with the facility's activities and processes;
3. Achieving continual improvement of the QEMS and the facility's performance.

3.3 The Operational Plan for the facility listed above fulfils the requirements of the requirements of the Ministry's DWQMS (version 2.0). The 21 QEMS Procedures within this Operational Plan align with the 21 elements of the DWQMS.

## 4. Related Documents

Ontario's Drinking Water Quality Management Standard, as amended from time to time



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-01  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 2 of 2

**QUALITY & ENVIRONMENTAL MANAGEMENT SYSTEM (QEMS)**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

All QEMS Procedures and Documents referenced in this Operational Plan

## 5. Revision History

Date	Revision #	Reason for Revision
Sep. 14, 2022	0	Procedure issued
Oct. 11, 2023	1	Added water tower to Step 3.1 and version 2.0 to the DWQMS in Step 3.3
Jul. 8, 2024	2	Procedure updated definition of DWQMS, added definition of Ministry as the Ontario government ministry responsible for drinking water and environmental legislation to alleviate need for future revisions if/when the Ministry experiences name changes, added "as amended from time to time directly following reference to Ontario's DWQMS to point to the most current version of the document. Removed watermark.



Ontario Clean Water Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-02  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 1 of 2

### QUALITY & ENVIRONMENTAL MANAGEMENT SYSTEM (QEMS) POLICY

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

## 1. Purpose

To document a QEMS Policy that provides the foundation for OCWA's Quality & Environmental Management System.

## 2. Definitions

*Quality Management System Policy* – means the policy described in Element 2 developed for the Subject System or Subject Systems

## 3. Procedure

3.1 The Ontario Clean Water Agency, its Board of Directors, Officers and entire staff are committed to the principles and objectives set out in our QEMS Policy.

OCWA's Policy is to:

- Deliver safe water and wastewater services that protect public health, the environment, and the sustainability of communities.
- Comply with applicable legislation and regulations.
- Promote client, consumer and stakeholder confidence through service excellence, effective communications and reporting.
- Train staff on their QEMS responsibilities.
- Maintain and continually improve the QEMS.

Originally issued as Environmental Policy on June 8, 1995

**Last revised, approved by OCWA's Board of Directors on April 4, 2024**

(This policy is annually reviewed)

3.2 Our Board of Directors, Officers and entire staff will act to ensure the implementation of this Policy and will monitor progress of the Quality & Environmental Management System (QEMS).

3.3 OCWA's QEMS Policy is readily communicated and available to all OCWA personnel, through OCWA's intranet. The Owner and members of the public can access the policy through OCWA's public website ([www.ocwa.com](http://www.ocwa.com)). A hardcopy of the QEMS Policy is posted as specified in the OP-05 Document and Records Control procedure.

3.4 Essential suppliers and service providers are advised of OCWA's QEMS Policy as per the OP-13 Essential Supplies and Services procedure.



Ontario Clean Water Agency

# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-02  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 2 of 2

## QUALITY & ENVIRONMENTAL MANAGEMENT SYSTEM (QEMS) POLICY

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager


- 3.5 Corporate Compliance coordinates the annual review and approval of the QEMS Policy by the Board of Directors and communicates the approval to all OCWA employees via an electronic communication.
- 3.6 The current version of the policy indicates the date of the last revision and that the policy is annually reviewed. Electronic and hard-copy documents that include the QEMS Policy will only be required to be updated in years when the Policy has been revised. A complete review/revision history of the QEMS Policy (documenting the annual policy review and/or revision approval date) is accessible to all staff on OCWA's intranet and is available upon request for external stakeholders.

### 4. Related Documents

- Current QEMS Policy (Posted on OCWA's intranet and internet)
- QEMS Policy Revision History (Posted on OCWA's intranet)
- OP-05 Document and Records Control
- OP-13 Essential Supplies and Services

### 5. Revision History

Date	Revision #	Reason for Revision
Sep. 14, 2022	0	Procedure issued
Oct. 11, 2023	1	Revised Step 3.1 to change "last revised" from the statement "Last revised, approved by OCWA's Board of Directors on April 6, 2016" to reviewed and approved". Reviews and approvals of the policy are conducted by the board every year. Revisions are done as needed.
Jul. 8, 2024	2	The first bullet of the QEMS Policy (approved in 2016) was revised to align with OCWA's updated Mission statement. Sections 3.3 and 3.6 were modified to add information/clarify how to access the QEMS Policy and the Policy revision history document. Removed watermark.

	<b>OPERATIONAL PLAN</b> Cobalt Drinking Water System	QEMS Proc.: OP-03 Rev Date: 2024-08-07 Rev No: 2 Pages: 1 of 2
<b>COMMITMENT AND ENDORSEMENT</b>		
Reviewed by: I. Bruneau, QEMS Representative	Approved by: B. Logan, Sr. Operations Manager	

## 1. Purpose

To document the endorsement of the Operational Plan for the Cobalt Drinking Water System by OCWA Top Management and the Town of Cobalt (Owner) and to set out when re-endorsement would be required.

## 2. Definitions

*Top Management* – a person, persons or a group of people at the highest management level within an Operating Authority that makes decisions respecting the QEMS and recommendations respecting the Subject System or Subject Systems

## 3. Procedure

3.1 The Operational Plan is provided to OCWA Top Management and to the Owner for endorsement. The signed written endorsement is presented in Appendix OP-03A. At a minimum, two members of Top Management must endorse the Operational Plan; however, the Operational Plan is made available to all members of Top Management in the specified document control location (refer to OP-05 Document and Records Control). Endorsement by OCWA’s Top Management is represented by the Senior Operations Manager and the Safety Process and Compliance Manager or the Regional Hub Manager.

Endorsement by the Owner is represented by the Mayor and Town Manager.

3.2 Any major revision of the operational plan will be re-endorsed by Top Management and the Owner. Major revisions include:

1. A revision to the QEMS Policy;
2. A change to both representatives of the facility’s Top Management and/or both of the Owner’s representatives that endorsed the Operational Plan;
3. A modification to the drinking water system processes/components that would require a major change to the description in OP-06 Drinking Water System;
4. The addition of a drinking water subsystem owned by the same Owner to this operational plan.

Any other changes would be considered a minor change and would not require the Operational Plan to be re-endorsed.

## 4. Related Documents

OP-03A Signed Commitment and Endorsement  
OP-05 Document and Records Control  
OP-06 Drinking Water System



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-03  
Rev Date: 2024-08-07  
Rev No: 2  
Pages: 2 of 2

**COMMITMENT AND ENDORSEMENT**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

**5. Revision History**

<b>Date</b>	<b>Revision #</b>	<b>Reason for Revision</b>
Mar. 17, 2022	0	Procedure issued
Oct. 11, 2023	1	Updated step 3.1 to include representatives of the Owner who are responsible for re-endorsement of the Operational Plan
Jul. 8, 2024	2	Updated step 3.1 to include the Safety Process and Compliance Manager as a member of Top Management that can endorse the plan and to include the Owner representatives. Revised Step 3.2(4) to clarify the addition of a subsystem must be owned by the same Owner to the Plan. Removed watermark.





**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Doc: OP-03A  
Rev Date: 2024 07 08  
Rev No: 2  
Pages: 1 of 1


**SIGNED COMMITMENT AND ENDORSEMENT**

This Operational Plan sets out the framework for OCWA' Quality & Environmental Management System (QEMS) that is specific and relevant to your drinking water system(s) and supports the overall goal of OCWA and the Town of Cobalt (Owner) to provide safe, cost-effective drinking water through sustained cooperation. OCWA will be responsible for developing, implementing, maintaining and continually improving its QEMS with respect to the operation and maintenance of the Cobalt Drinking Water System (DWS) and will do so in a manner that ensures compliance with applicable legislative and regulatory requirements.


Through the endorsement of this Operational Plan, the Owner commits to work with OCWA to facilitate this goal.

**OCWA Top Management  
Endorsement**

**Owner Endorsement**

  
\_\_\_\_\_  
Bryce Logan  
Senior Operations Manager,  
Temiskaming Shores Cluster


aug 10 / 24  
\_\_\_\_\_  
Date

  
\_\_\_\_\_  
Steven Dalley  
Town Manager, Town of Cobalt

July 30, 2024  
\_\_\_\_\_  
Date

  
\_\_\_\_\_  
Eric Nielson  
Regional Hub Manager,  
Northeastern Ontario Regional Hub

Aug 6 / 24  
\_\_\_\_\_  
Date

  
\_\_\_\_\_  
Angela Adshead  
Mayor, Town of Cobalt

July 30, 2024  
\_\_\_\_\_  
Date



Ontario Clean Water Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-04  
Rev Date: 2022-03-17  
Rev No: 0  
Pages: 1 of 1

### QUALITY & ENVIRONMENTAL MANAGEMENT SYSTEM (QEMS) REPRESENTATIVE

Reviewed by: R. Marshall, QEMS Representative

Approved by: Y. Rondeau, SPC Manager

#### 1. Purpose

To identify and describe the specific roles and responsibilities of the QEMS Representative(s) for the Cobalt Drinking Water System.

#### 2. Definitions

None

#### 3. Procedure

3.1 The role of QEMS Representative for the Cobalt Drinking Water System is the Ontario Clean Water Agency, represented by the designated Process and Compliance Technician (PCT). The Safety, Process and Compliance Manager (or alternate PCT) will act as an alternate QEMS Representative when required.

3.2 The QEMS Representative is responsible for:

- Administering the QEMS for the Cobalt Drinking Water System by ensuring that processes and procedures needed for the facility's QEMS are established and maintained;
- Reporting to Top Management on the facility's QEMS performance and identifying opportunities for improvement;
- Ensuring that current versions of documents related to the QEMS are in use;
- Promoting awareness of the QEMS to all operations personnel; and
- In conjunction with Top Management, ensuring that operations personnel are aware of all applicable legislative and regulatory requirements that pertain to their duties for the operation of the system.

#### 4. Related Documents

None

#### 5. Revision History

Date	Revision #	Reason for Revision
Mar. 17, 2023	0	Procedure issued



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-05  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 1 of 5

## DOCUMENT AND RECORDS CONTROL

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

### 1. Purpose

To describe how OCWA's QEMS documents are kept current and how QEMS documents and records are kept legible, readily identifiable, retrievable, stored, protected, retained and disposed of. This procedure applies to QEMS Documents and QEMS records pertaining to the Cobalt Drinking Water System as identified in this procedure.

### 2. Definitions

*Document* – includes a sound recording, video tape, film, photograph, chart, graph, map, plan, survey, book of account, and information recorded or stored by means of any device

*Record* – a document stating results achieved or providing proof of activities performed

*QEMS Document* – any document required by OCWA's QEMS as identified in this procedure

*QEMS Record* – any record required by OCWA's QEMS as identified in this procedure

*Controlled* – managed as per the conditions of this procedure

*Retention Period* – length of time that a document or record must be kept; starts from the date of issue for QEMS records or from the point of time when a QEMS document is replaced by a new or amended document

### 3. Procedure

- 3.1 Documents and records required by OCWA's QEMS and their locations are listed in Appendix OP-05A Document and Records Control Locations.
- 3.2 Internally developed QEMS documents and QEMS records (whenever possible) are generated electronically to ensure legibility and are identified through a header/title and revision date. Handwritten records must be legible and permanently rendered in ink or non-erasable marker.
- 3.3 Controls for the Operational Plan include the use of an authorized approval and a header on every page that includes a title, alpha-numeric procedure code, revision date, revision number and page numbers. A revision history is also included in the body of each procedure.

Authorized personnel for review and approval of this Operational Plan are:

Review: QEMS Representative, Operations Supervisor or ORO

Approval: Safety Process and Compliance Manager or Senior Operations Manager



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-05  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 2 of 5

## DOCUMENT AND RECORDS CONTROL

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

The QEMS Representative ensures that updated documents are provided to the above authorized personnel for review or approval prior to issuance. Authorized personnel authenticate their review/approval of this Operational Plan via email.

- 3.4 The QEMS Representative is responsible for ensuring that current versions of QEMS documents are being used at all times. Current QEMS documents and records are readily accessible to operations personnel and to internal and external auditors/inspectors at established document control locations. The currency of internal documents is ensured by comparing the date on the document to that of the master hardcopy and/or electronic copy residing in the designated document control location(s) specified in Appendix OP-05A.

Document control locations are established in areas that provide adequate protection to prevent unauthorized use/access, damage, deterioration or loss of QEMS documents and records. Copies of QEMS documents and records located outside of designated control locations are considered uncontrolled.

- 3.5 Access to OCWA's computer network infrastructure is restricted through use of individually-assigned usernames and passwords and local area servers. Network security is maintained by OCWA's Information Technology department through a number of established mechanisms and practices such as daily back-up of files stored on servers, password expiry, limitations on login attempts, multi-factor authentication and policies outlining specific conditions of use.

Access to facility QEMS records contained within internal electronic databases and applications (e.g., Wonderware, OPEX, PDM, WMS) is administered by designated application managers/trustees, requires the permission of Operations Management and is restricted through use of usernames and passwords. Records are protected by means of regular network back-ups of electronic files stored on servers and/or within databases.

- 3.6 Any employee of the drinking water system may make a verbal or written request for a revision be made to improve an existing internal QEMS document or the preparation of a new document. These requests are to be made to the QEMS Representative and should indicate the reason for the change. The need for new or updated documents may also be identified through the Management Review or system audits.

The QEMS Representative communicates any changes made to QEMS documents to relevant operations personnel and coordinates related training (as required). Changes to corporately controlled QEMS documents are communicated and distributed to facility QEMS Representatives by OCWA's Corporate Compliance Group through e-mails, memos and/or provincial, regional hub/cluster or facility-level training sessions.

Plant SCADA records are maintained as per Appendix OP-05A and are accessible when required. SCADA records are stored on a redundant hard drive. Data can be retrieved from reports generated by the SCADA computer which is password protected or hard copy reports which are printed daily by operators and kept at the Cobalt water treatment plant.



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-05  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 3 of 5

**DOCUMENT AND RECORDS CONTROL**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

The SCADA system is located in secured, locked building with limited authorized access. The building is equipped with alarm systems and security cameras.

- 3.7 When a QEMS document is superseded, the hardcopy and the electronic copy of the document (as applicable) are promptly removed from the applicable designated document control locations specified in OP-05A. The QEMS Representative ensures that the hardcopy and electronic copy are disposed of or retained (as appropriate)
- 3.8 The authorized method for disposal of hardcopy documents and records after the specified retention requirements have been met is shredding. The authorized method for disposal of electronic documents and records after the specified retention requirements have been met is deleting.
- 3.9 QEMS documents and records are retained in accordance with applicable regulations and legal instruments. Relevant regulatory and corporate minimum retention periods are as follows:

Type of Document/Record	Minimum Retention Time	Requirement Reference
Operational Plan (OP-01 to OP-21 and appendices, including Schedule "C" – Subject System Description Form) FEP Long term forecast of major infrastructure maintenance, rehabilitation and renewal activities Sampling plan/schedule/ calendar	10 years	Director's Direction under SDWA
Internal QEMS Audit Results	10 years	OCWA Requirement
External QEMS Audit Results	10 years	OCWA Requirement
Management Review Documentation	10 years	OCWA Requirement
Documents/records required to demonstrate conformance with the DWQMS (specifically all the documents/records listed in OP-05A)	3 years*if no specified legislative requirement below* identified in this table or in the facility's legal instruments *	OCWA Requirement
Log Books or other record-keeping mechanisms	5 years	O. Reg. 128/04
Training Records for water operators and water quality analysts	5 years	O. Reg. 128/04
Operational checks, sampling and testing (e.g., chlorine residuals, turbidity, fluoride, sampling records), microbiological sampling and testing and chain of custodies	2 years	O. Reg. 170/03



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-05  
 Rev Date: 2024-07-08  
 Rev No: 2  
 Pages: 4 of 5

### DOCUMENT AND RECORDS CONTROL

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Type of Document/Record	Minimum Retention Time	Requirement Reference
Schedule 23 & 24 sampling, chain of custodies and test results	6 years LMR 15 years SMR	O. Reg. 170/03
THM, HAA, nitrates, nitrites and lead program (including pH and alkalinity) sampling, chain of custodies, and test results, Section 11 Annual Reports and Schedule 22 Summary Reports	6 years	O. Reg. 170/03
Sodium sampling, chain of custody and test results and related corrective action records/reports, 60 month fluoride sampling, chain of custody and test results (if the system doesn't fluoridate), Engineering Reports, GUDI/Non-GUDI Reports	15 years	O. Reg. 170/03
Corrective action records/reports for E. Coli, Total Coliforms and bacterial species	2 years	O. Reg. 170/03
Corrective action records/reports for chemical and radiological parameters under SDWA O. Reg. 169/03, pesticides not listed under O. Reg. 169/03 and health-related parameters in an order or approval	6 years (LMR) 15 years (SMR)	O. Reg. 170/03
Flow Meter Calibration Records, Analyzer Calibration Reports Maintenance Records/Work Orders	2 years	O. Reg. 170/03
Records by or created in accordance with the Municipal Drinking Water Licence (MDWL) or Drinking Water Works Permit (DWWP). Except records specifically referenced in O. Reg. 170/03 or otherwise specified in the MDWL or DWWP.	5 years	MDWL
Ministry forms referenced in the DWWP, including Form 1, Form 2, Form 3 and Director Notifications (applies to forms that have been completed by OCWA as the authorized by the owner)	10 years	DWWP

3.10 The Operational Plan is reviewed for currency by the QEMS Representative during internal/external audit and Management Review processes. Other QEMS-related documents are reviewed as per the frequencies set out in this Operational Plan or as significant changes (e.g., changes in regulatory requirements, corporate policies or operational processes and/or equipment, etc.) occur. QEMS documents and records are reviewed for evidence of control during each internal system audit as per OP-19 Internal QEMS Audits.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-05  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 5 of 5

### DOCUMENT AND RECORDS CONTROL

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

#### 4. Related Documents

- OP-05A Document and Records Control Locations
- OP-19 Internal QEMS Audits
- OP-20 Management Review

#### 5. Revision History

Date	Revision #	Reason for Revision
Sep. 14, 2022	0	Procedure issued
Oct. 11, 2023	1	Changed position of Team Lead to Operations Supervisor in Step 3.3
Jul. 8, 2024	2	Procedure updated to add multi factor authentication to Step 3.5. A description of how SCADA records are maintained was added to Step 3.6. Table in Step 3.9 revised to include Schedule 23 & 24 records retention times for Large Municipal Residential (LMR) and Small Municipal Resident (SMR) systems, added chain of custody as record for retention for various sampling requirements, lead program clarified to include pH and alkalinity; added GUDI/Non-GUDI Reports. Removed watermark.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Doc: OP-05A  
 Rev Date: 2024-07-08  
 Rev No: 2  
 Pages: 1 of 4

<b>DOCUMENT AND RECORDS CONTROL LOCATIONS</b>	
Reviewed by: I. Bruneau, QEMS Representative	Approved by: B. Logan, Sr. Operations Manager

### Designated locations for documents and records required by OCWA's QEMS

Type of Document/Record	Designated Document Control Location (HC = Hardcopy, E = Electronic)
<b>Internal QEMS Documents</b>	
Corporate Emergency Response Plan (CERP)	EC - OCWA's Sharepoint site <a href="https://ocwa365.sharepoint.com">https://ocwa365.sharepoint.com</a>
Facility Emergency Plan (FEP) Binder (includes Emergency Contact List, Essential Supplies and Services List, OCWA's Emergency Communications Protocol, Contingency Plans, Site Specific Emergency Procedures and OCWA's Emergency Management Program)	HC - Cobalt Water Treatment Plant
OCWA's Health & Safety Management System	EC - OCWA's Sharepoint Site <a href="https://ocwa365.sharepoint.com">https://ocwa365.sharepoint.com</a>
On-call Schedule	EC - Microsoft Outlook Shared Calendar
Operational Plan (OP-01 to OP-21 and appendices, including Schedule "C" – Subject System Description Form)	EC - \\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems EC - Municipal Website <a href="https://cobalt.ca/residents/municipal-services/#1652963793627-091f9918-948f">https://cobalt.ca/residents/municipal-services/#1652963793627-091f9918-948f</a> HC - Haileybury Water Treatment Plant
ORO Letter	EC - \\ocwfilereg\NEO Collab\NEO DWQMS
QEMS Policy	EC - OCWA's public website <a href="http://www.ocwa.com">www.ocwa.com</a> & OCWA's Sharepoint Site ( <a href="https://ocwa365.sharepoint.com">https://ocwa365.sharepoint.com</a> ) HC - Haileybury Water Treatment Plant
Sampling Schedule	EC - \\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems HC – Temagami North/South Water Treatment Plant
Vacation Calendar	EC - Microsoft Outlook Shared Calendar
<b>Internal QEMS Forms (blank)</b>	
Analysis and Action Plan (AAP) Form	EC - \\ocwfilereg\NEO Collab\NEO DWQMS
Community Complaint Form	
Contingency Plan Review/Test Summary Form	
Distribution Maintenance and Repair Form	
Environmental Incident Report Form	
Facility Rounds Sheets	
Incidents of Non-Compliance Form	
Instrumentation Calibration/Maintenance Report Form	
Laboratory Chain of Custody Forms	
Loss of Pressure Incident Form	
QEMS – Summary of Findings Spreadsheet	
Tailgate Meeting Form	





Ontario Clean Water Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Doc: OP-05A  
 Rev Date: 2024-07-08  
 Rev No: 2  
 Pages: 2 of 4

### DOCUMENT AND RECORDS CONTROL LOCATIONS

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Type of Document/Record	Designated Document Control Location (HC = Hardcopy, E = Electronic)
Watermain Commissioning Form	
<b>External QEMS Documents</b>	
American Water Works Association (AWWA) Standards (as referenced in the DWWP) & Ontario's Watermain Disinfection Procedure	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS</a>
ANSI/NSF product registration documentation for Chemicals/Materials Used	EC - <a href="https://info.nsf.org/Certified/PwsChemicals/">https://info.nsf.org/Certified/PwsChemicals/</a>
Applicable Federal and Provincial Legislation	Provincial Online at <a href="http://www.e-laws.gov.on.ca">www.e-laws.gov.on.ca</a> Federal online at <a href="http://www.laws.justice.gc.ca">www.laws.justice.gc.ca</a>
DWQMS Standard	EC - <a href="https://www.ontario.ca">https://www.ontario.ca</a>
Engineering schematics/plans/drawings	HC – Cobalt Water Treatment Plant
Equipment Operation/Maintenance Manuals	HC - Cobalt Treatment Plant EC - Internet
Legal Instruments: Municipal Drinking Water Licence (MDWL) / Drinking Water Works Permit (DWWP) / Permit to Take Water (PTTW)	HC - Cobalt Treatment Plant EC <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Ministry Inspection Reports	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Municipal By-laws	Municipal Office
Operations Manual (including standard operating procedures)	HC – Cobalt Water Treatment Plant
Operator Certificates	HC – Haileybury Water Treatment Plant
<b>External QEMS Forms (blank)</b>	
Adverse Water Quality Incident (AWQI) Form	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS</a>
Ministry forms referenced in the Drinking Water Works Permit, including Form 1, Form 2, Form 3 and Director Notifications	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS</a>
<b>QEMS Records</b>	
Adverse Water Quality Incident (AWQI) Reports	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Analysis and Action Plan (AAP) Report	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Annual Compliance / Summary Reports for Municipalities	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Audit Reports - External	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Audit Reports - Internal	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Call Back Reports	EC - Workplace Management System (Maximo)
Confined Space Records (Entry Permits/Coordination Documents)	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\NEO - Health and Safety</a>
Community Complaint Records	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>



Ontario Clean Water Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Doc: OP-05A  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 3 of 4

### DOCUMENT AND RECORDS CONTROL LOCATIONS

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Type of Document/Record	Designated Document Control Location (HC = Hardcopy, E = Electronic)
Contingency Plan Review/Test Results	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Temiskaming Shores Cluster - Common</a>
Distribution Maintenance and Repair Records	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Environmental Incident Reports	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Facility Logbooks	HC - Cobalt Water Treatment Plant (old versions)
Facility E-Logbooks	EC - <a href="https://ocwa.eriscloud.com/">https://ocwa.eriscloud.com/</a> EC - eRIS Application (mobile or tablet device)
Facility Visitor Logbook	HC – Cobalt Water Treatment Plant
Facility Rounds Sheets	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a> HC - Haileybury Water Treatment Plant
Generator Maintenance Sheets	HC - Haileybury Water Treatment Plant – Facility Binders
Incidents of Non-Compliance Records	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Infrastructure Review (Capital Letter & Capital/Major Maintenance Recommendations)	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Laboratory Analytical Reports and completed Chain of Custody Forms	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Loss of Pressure Incident Reports	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Maintenance & Calibration Records (completed WMS work orders)	EC - Workplace Management System (WMS)
Management Review Documentation	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Ministry forms referenced in the Drinking Water Works Permit, including Form 1, Form 2, Form 3 and Director Notifications	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Operator Training Records	EC - OCWA's Training Summary Database
External QEMS Communications (including essential suppliers and service providers)	E – Microsoft Outlook E-mail E - Maintained on <a href="#">\\ocwfilereg\NEO Collab</a>
QEMS Communications - Internal	EC - Microsoft Outlook E-mail
QEMS – Summary of Findings (Preventive/Corrective) Records	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
Quarterly Operations Reports (to the Owner)	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>
SCADA Records (Wonderware, OCWA)	EC - maintained through Wonderware
SCADA Records (Plant SCADA, Client Owned)	EC - maintained through SCADA network
Tailgate Records	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\NEO - Health and Safety</a>
Watermain Commissioning Records	EC - <a href="#">\\ocwfilereg\NEO Collab\NEO DWQMS\DWQMS - Cobalt Drinking Water Systems</a>



Ontario Clean Water Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Doc: OP-05A  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 4 of 4

### DOCUMENT AND RECORDS CONTROL LOCATIONS

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

## Revision History

Date	Revision #	Reason for Revision
Sep. 14, 2022	0	Appendix issued
Oct. 11, 2023	1	Updated table to include section for QEMS Internal blank forms, and External QEMS blank forms. Changed location of the Operational Plan from the Municipal Office to the Municipal website
Jul. 8, 2024	2	Updated Corporate Emergency Plan (CERP) name and change MECP to Ministry. Updated location for applicable Provincial and Federal regulations. Updated Call-in Reports to Call Back Reports to reflect reports in Maximo. Added Watermain Commissioning form and records to the table. Removed watermark.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-06  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 1 of 7

### DRINKING WATER SYSTEM

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

## 1. Purpose

To document the following for the Cobalt Drinking Water System:

- The name of the Owner and Operating Authority; and
- Provide a description of the system, including all applicable water sources, treatment system processes and distribution system components.

## 2. Definitions

*Distribution System* - means the part of a drinking water system that is used in the distribution, storage or supply of water and that is not part of a treatment system.

*Primary Disinfection* - means a process or series of processes intended to remove or inactivate human pathogens such as viruses, bacteria and protozoa in water.

*Secondary Disinfection* - means a process or series of processes intended to provide and maintain a disinfectant residual in a drinking water system's distribution system, and in plumbing connected to the distribution system, for the purposes of:

- (a) protecting water from microbiological re-contamination;
- (b) reducing bacterial regrowth;
- (c) controlling biofilm formation;
- (d) serving as an indicator of distribution system integrity; and

includes the use of disinfectant residuals from primary disinfection to provide and maintain a disinfectant residual in a drinking water system's distribution system for the purposes described in clauses (a) to (d).

*Treatment System* - means any part of a drinking water system that is used in relation to the treatment of water and includes,

- (a) anything that conveys or stores water and is part of a treatment process, including any treatment equipment installed in plumbing,
- (b) anything related to the management of residue from the treatment process or the management of the discharge of a substance into the natural environment from the system, and
- (c) a well or intake that serves as the source or entry point of raw water supply for the system;

## 3. Procedure

### 3.1 Drinking Water System Overview

#### *Owner / Operating Authority*

The Cobalt Drinking Water System is owned by The Corporation of the Town of Cobalt and consists of a Class 2 water treatment subsystem and a Class 1 water distribution subsystem. The Ontario Clean Water Agency (OCWA) is the accredited operating authority



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-06  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 2 of 7

**DRINKING WATER SYSTEM**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

and is designated as the Overall Responsible Operator for both the water treatment and water distribution facilities.

The Cobalt Drinking Water System also provides water to the Coleman Distribution System which is owned by the Township of Coleman.

### 3.2 Source Water

#### *Raw Water Supply*

The raw water is taken from a protected water body, Sasaginaga Lake and directed to the water treatment plant located about 500 meters West of Pyrite Street in Cobalt. The intake structure is located 191 meters into the lake, at a depth of 7.5 meters and is equipped with a 244 mm diameter drum base with a 560 mm diameter manually adjustable conical cover. The raw water intake pipe consists of a 215 m long, 450 mm diameter polyethylene intake pipe with a design capacity of 8726 m<sup>3</sup>/day.

A flow meter is located in the water treatment plant to monitor raw water flows. The raw water is also continuously monitored for pH, turbidity and temperature.

#### *General Characteristics*

The water from Sasaginaga Lake is typically low in turbidity and has a fairly stable pH. Bacteriological analysis of the raw water indicates a source of relatively good quality. The results of chemical analyses are consistently below the Ontario Drinking Water Quality Standards.

#### *Sasaginaga Lake: Raw Water Characteristics*

Characteristics	2017		2018		2019		2020		2021	
	Min - Max	Mean	Min - Max	Mean	Min - Max	Mean	Min - Max	Mean	Min -Max	Mean
<i>E. coli</i> (CFU/100 mL)	<2 - 5	2.16	<2 - 5	2.2	<2 - 130	5	0 - 5	2.1	<2 - 10	3.18
Total Coliforms (CFU/100 mL)	<2 - 158	26	<2 - 158	49	<2 - 400	80	<2 - 348	53.4	<2 - 620	88
Turbidity (NTU)	0.5 - 4.7	1.6	0.5 - 4.7	2.35	0.34 - 4.5	0.93	0.9 - 2.2	1.3	0.8 - 6.8	1.58
pH	6.5 - 7.7	7.4	6.5 - 7.7	7.14	6.2 - 8	6.8	6.6 - 7.6	7	6.9 - 7.4	7.2

#### *Common Fluctuations*

Changes to raw water alkalinity and turbidity occurs during spring runoff and significant rainfall events. As well, water temperature changes significantly from winter to summer. Warm summer temperatures may result in an increase of taste and odour concerns. Chemical adjustments are made accordingly to assist with filtration process.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-06  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 3 of 7

### DRINKING WATER SYSTEM

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

#### *Threats*

Potential sources of raw water contamination include fuel spills from recreational water crafts and possible future mining activity.

#### *Operational Challenges*

Spring and fall turnover is the greatest operational challenge for the Cobalt DWS. The turnover creates higher demands on process operations. It can affect the source waters alkalinity, pH, temperature and turbidity. These changes can occur quickly and require adjustments to chemical dosages.

### 3.3 Treatment System Description

#### *Water Treatment*

The Cobalt water treatment facility is a direct filtration facility with two treatment trains operating in parallel, and each consisting of coagulant addition, pH adjustment (if needed), pre-contact tanks, two dual media pressure filters, primary disinfection by ultraviolet light (UV) irradiation and chlorine gas.

The low lift pumping station consists of two submersible pumps (one duty and one standby) each rated at 36 L/s, a wet well, a flow meter and two pre-contact vessels, each having a volume of 3.6 cubic meters. Poly Aluminum Chloride (PAC) is added prior to the pre-contact tank for coagulation and flocculation. The pumps feed four (4) pressurized dual media sand/anthracite filters. Each filter is equipped with turbidimeters to monitor filtered effluent.

Water is then directed to two (2) parallel UV irradiation systems which are used to achieve most of the required primary disinfection. Each unit is rated at 3974 m<sup>3</sup>/day at a 85% UVT with a design dose of 40 mJ/cm<sup>2</sup> and is equipped with actuated control valves that allow switchover between units.

Chlorine gas is injected into the water following UV treatment using two booster pumps and two manually controlled v-chlorination feed units capable of providing 45.0 kilograms/day of chlorine. The chlorine is added to meet the remaining primary disinfection requirements and maintain the required secondary disinfection within the distribution systems.

#### *Water Storage and Pumping Capabilities*

The water then goes into a 8.527 m diameter and 10.869 m high glassed fused to steel standpipe located outside the water treatment plant. It has a total volume of 621 m<sup>3</sup> and is equipped with 150 inlet pipe and a 200 mm outlet pipe as well as an 200 mm overflow pipe discharging to an overflow pad. Two submersible high lift pumps (one duty and one



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-06  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 4 of 7

### DRINKING WATER SYSTEM

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

standby) pump water from the standpipe to the Cobalt and Coleman Distribution Systems and to the Cobalt water tower.

Before entering the distribution system, the treated water is monitored for flow, pH, free chlorine residual and turbidity using continuous on-line analyzers. The plant is protected with alarms and a stand-by generator in the event of power loss.

#### *Control System*

The Cobalt Water Treatment System is controlled by a dedicated Programmable Logic Controller (PLC) and monitored through a Control System Supervisory Control and Data Acquisition (SCADA) system. All analyzing, monitoring and control module equipment information is routed through the SCADA system for operator monitoring and control. Control of equipment can be accomplished locally using the SCADA computer or remotely using operator computers and cell phones. Alarm capability and set point adjustment along with trend monitoring are also available through SCADA system controls.

#### *Emergency Power*

A 180 kW diesel generator with a 1500 Liter fuel tank is available outside of the water treatment plant and is capable of supplying power to the facility during power failures.

### **3.4 Treatment System Process Flow Chart**

Refer to Figure 1 on page 6


### **3.5 Description of the Distribution System Components**

The Cobalt drinking water system is classified as a Large Municipal Residential Drinking Water System and serves an approximate population of 1350 residents, including the connected population in the Coleman Distribution System. The Cobalt Distribution System is comprised of PVC water mains, 139 valves and approximately 615 service connections. There are 89 fire hydrants connected to the system to aid in fire protection.

The water tower, located on Ferland Avenue in the Town of Cobalt is a composite concrete/steel tank that was built in 1988. The off-site elevated water storage tank is 15m in diameter and 43.4m high and has a storage volume of 1400 cubic meters. It provides storage and maintains pressure in the distribution system during peak hours of demand. Re-chlorination equipment is on hand at the water tower to provide secondary disinfection if required.

#### *Downstream Processes*

The Cobalt water treatment plant provides drinking water to the Coleman Distribution System which consists of 47 service connections, 18 fire hydrants and associated valves. There are 2 separate connection points to the Town of Cobalt distribution system. The Coleman distribution

	<p align="center"><b>OPERATIONAL PLAN</b> Cobalt Drinking Water System</p>	<p>QEMS Proc.: OP-06 Rev Date: 2024-07-08 Rev No: 3 Pages: 5 of 7</p>
<p><b>DRINKING WATER SYSTEM</b></p>		
Reviewed by: I. Bruneau, QEMS Representative	Approved by: B. Logan, Sr. Operations Manager	

system infrastructure is owned by the Corporation of Coleman Township and the Operating Authority is the Ontario Clean Water Agency.

To maintain disinfection residuals in the Cobalt distribution system, the following processes are in place:

- The Cobalt distribution system will be, at all times; operated by a person(s) holding a valid operator’s certificate.
- All maintenance or repairs conducted in the distribution system will be communicated, in advance to the ORO to ensure disinfection is maintained and that all maintenance and repairs are supervised by a certified operator.
- Regular flushing of the distribution system will be performed.
- The system will be monitored and sampled as required by legislative requirements and any adverse results will be resampled and reported in accordance with the Safe Drinking Water Act and its regulations.
- OCWA, as the operating authority for the distribution system will ensure that treatment equipment that provides secondary disinfection is operated such that, at all times and at all locations in the receiving distribution system, the chlorine residuals are never less than 0.05 mg/L (free).
- A free chlorine residual below 0.2 mg/L in the distribution will initiate corrective actions to prevent an adverse water quality incident.

**3.6 Distribution System - Map**

Refer to Figure 2 on page 7

**4. Related Documents**

None





**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-06  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 6 of 7

**DRINKING WATER SYSTEM**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

## 5. Revision History

Date	Revision #	Reason for Revision
Mar. 1, 2022	0	Procedure issued
Oct. 24, 2022	1	Changed " <i>Distribution System Components Flow Chart to Distribution System Map</i> " on pg 3.
Oct. 11, 2023	2	Updated Section 3.2 to discuss turbidity and pH under General Characteristics of Raw Water. Updated Common Fluctuations, Threats and Operational Challenges. Added more information to the Treatment System Description and Distribution System Components. Added a section for Control System and Emergency Power. Provided information on how to maintain disinfection residuals in the Cobalt distribution system. Replaced the distribution map.
Jul. 8, 2024	3	Updated Step 3.2 to provide additional detail for the Raw Water Supply. Revised Step 3.5 to include a free chlorine value that will initiate corrective actions in the distribution system. Removed watermark.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

### DRINKING WATER SYSTEM

Reviewed by: I Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

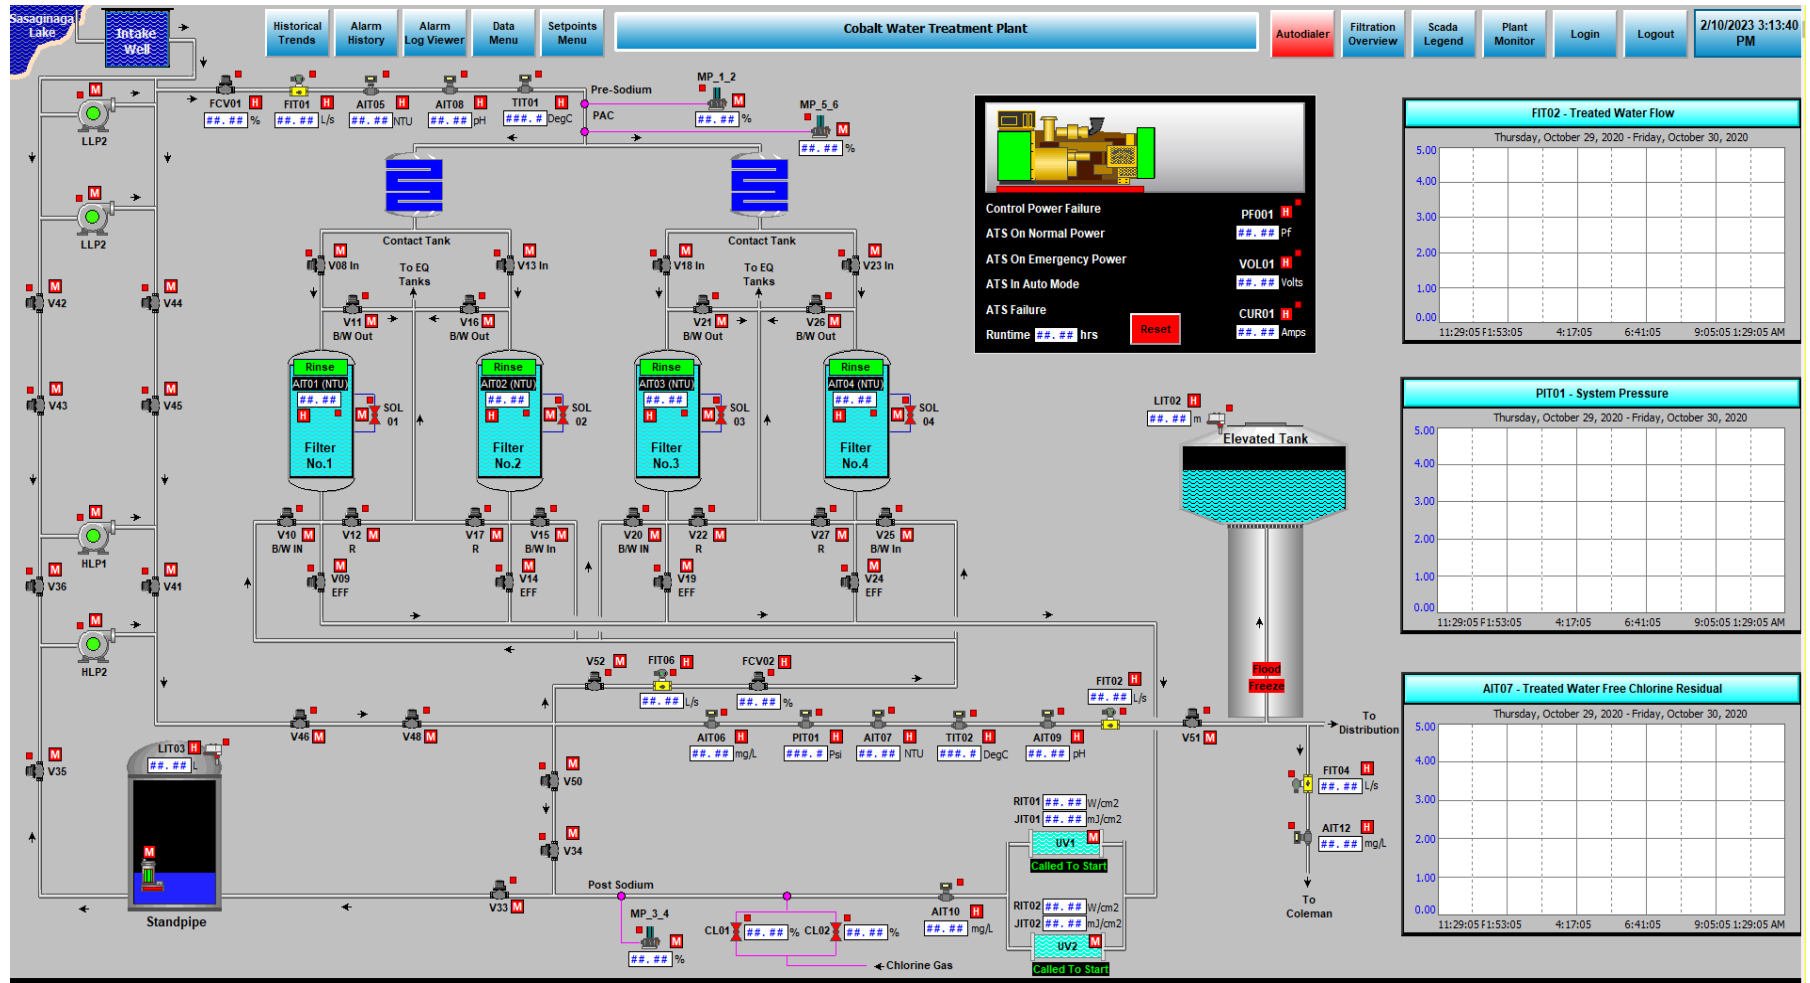


Figure 1 - Cobalt Water Treatment Plant - Process Flow Chart (2023)



Ontario  
Clean Water  
Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-06  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 8 of 8

### DRINKING WATER SYSTEM

Reviewed by: I Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

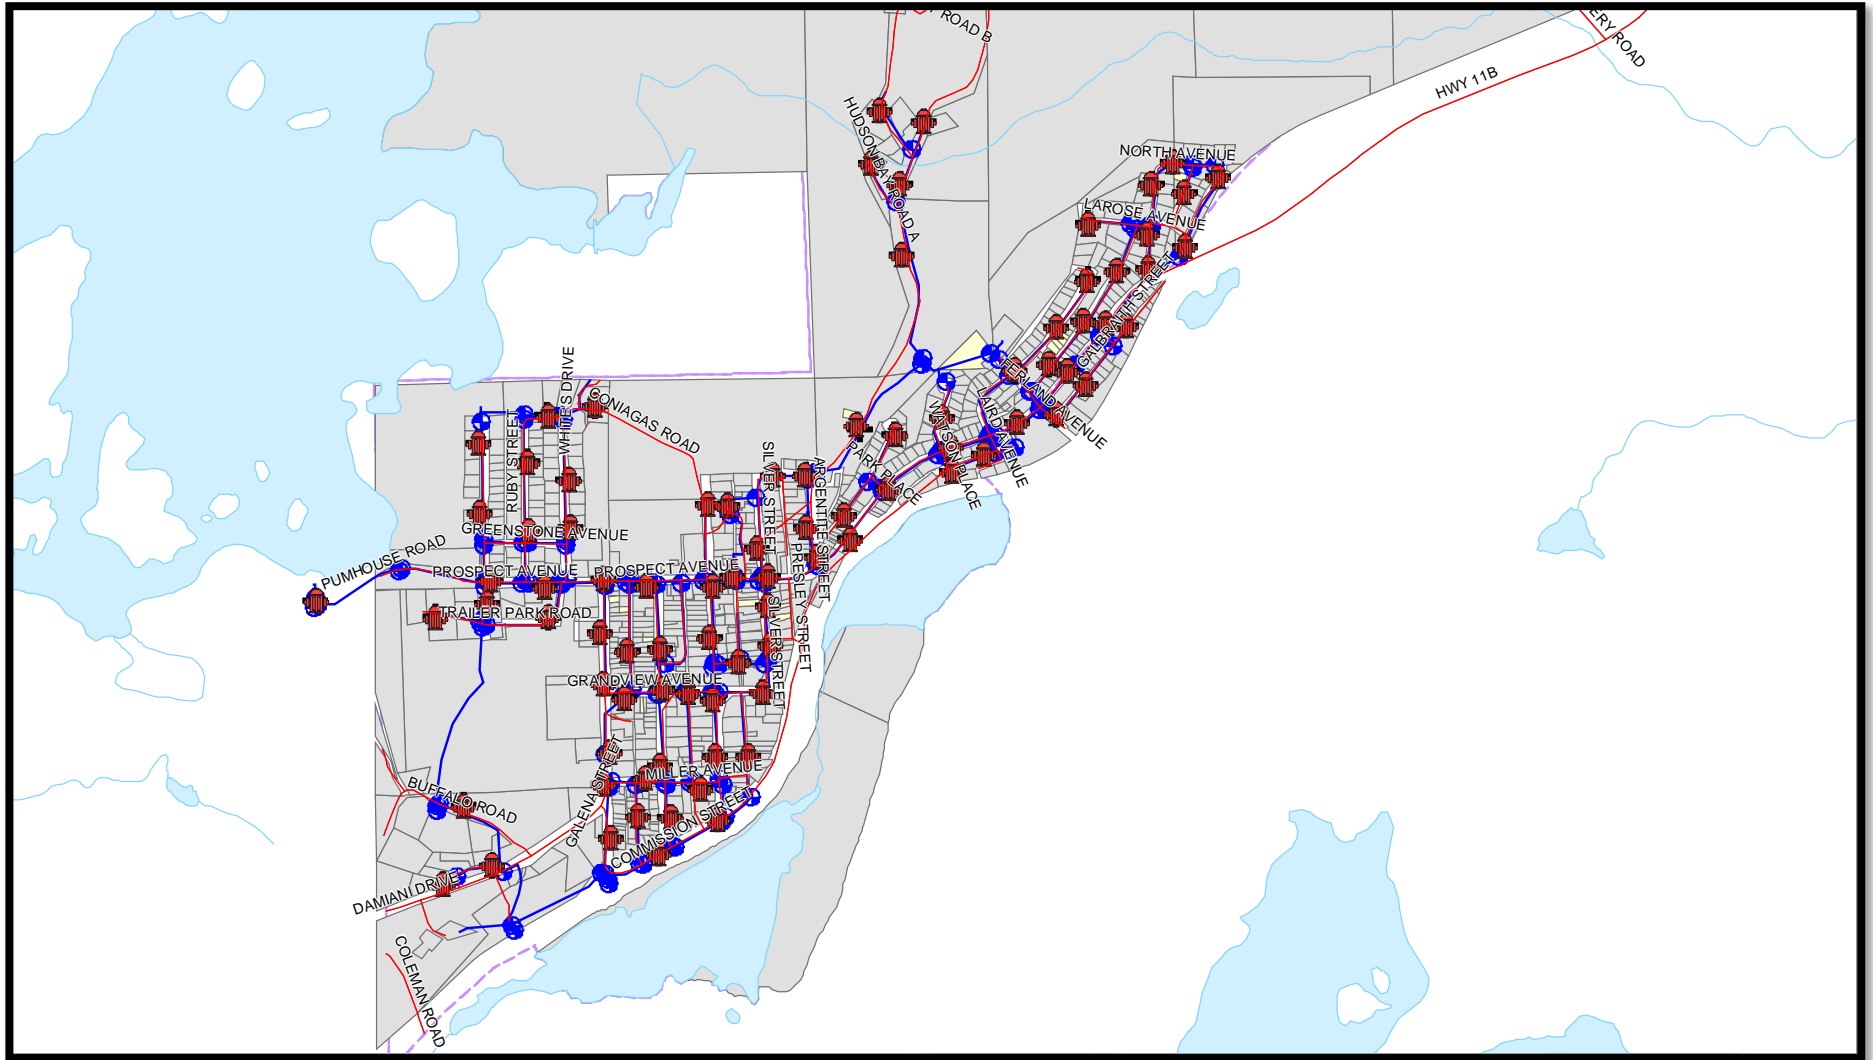


Figure 2 – Cobalt Distribution System Map



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-07  
Rev Date: 2022-09-14  
Rev No: 0  
Pages: 1 of 4

### RISK ASSESSMENT

Reviewed by: R. Marshall, QEMS Representative | Approved by: Y. Rondeau, SPC Manager

## 1. Purpose

To document the process for conducting a risk assessment to identify and assess potential hazardous events and associated hazards that could affect drinking water safety.

## 2. Definitions

*Consequence* – the potential impact to public health and/or operation of the drinking water system if a hazard/hazardous event is not controlled

*Control Measure* – includes any processes, physical steps or other practices that have been put in place at a drinking water system to prevent or reduce a hazard before it occurs

*Critical Control Point (CCP)* – An essential step or point in the subject system at which control can be applied by the Operating Authority to prevent or eliminate a drinking water health hazard or reduce it to an acceptable level

*Drinking Water Health Hazard* – means, in respect of a drinking water system,

- a) a condition of the system or a condition associated with the system's waters, including anything found in the waters,
  - i. that adversely affects, or is likely to adversely affect, the health of the users of the system,
  - ii. that deters or hinders, or is likely to deter or hinder, the prevention or suppression of disease, or
  - iii. that endangers or is likely to endanger public health,
- b) a prescribed condition of the drinking water system, or
- c) a prescribed condition associated with the system's waters or the presence of a prescribed thing in the waters

*Hazardous Event* – an incident or situation that can lead to the presence of a hazard

*Hazard* – a biological, chemical, physical or radiological agent that has the potential to cause harm

*Likelihood* – the probability of a hazard or hazardous event occurring

## 3. Procedure

- 3.1 Operations Management ensures that operations personnel are assigned to conduct a risk assessment at least once every thirty-six months. At a minimum, the Risk Assessment Team must include the QEMS Representative, at least one Operator for the system and at least one member of Operations Management.
- 3.2 The QEMS Representative is responsible for coordinating the risk assessment and ensuring that documents and records related to the risk assessment activities are maintained.

	<b>OPERATIONAL PLAN</b> Cobalt Drinking Water System	QEMS Proc.: OP-07 Rev Date: 2022-09-14 Rev No: 0 Pages: 2 of 4
<b>RISK ASSESSMENT</b>		
Reviewed by: R. Marshall, QEMS Representative	Approved by: Y. Rondeau, SPC Manager	

3.3 The Risk Assessment Team performs the risk assessment as follows:

- 3.3.1 OP-07 Risk Assessment and OP-08 Risk Assessment Outcomes are reviewed.
- 3.3.2 For each of the system’s activities/process steps, potential hazardous events and associated hazards (possible outcomes) that could impact the system’s ability to deliver safe drinking water are identified. At a minimum, potential hazardous events and associated hazard as identified in the most current version of the Ministry’s document titled “Potential Hazardous Events for Municipal Residential Drinking Water Systems” (as applicable to the system type) must be considered.
- 3.3.3 For each of the hazardous events, control measures currently in place at the system to eliminate the hazard or prevent it from becoming a threat to public health are specified. Control measures may include alarms, monitoring procedures, standard operating procedures/emergency procedures/contingency plans, preventive maintenance activities, backup equipment, engineering controls, etc.
- 3.3.4 To ensure that potential drinking water health hazards are addressed and minimum treatment requirements as regulated by SDWA O. Reg. 170/03 and the Ministry’s “Procedure for Disinfection of Drinking Water in Ontario” (as amended) are met, OCWA has established mandatory Critical Control Points (CCPs).

As a minimum, the following must be included as CCPs (as applicable):

- Equipment or processes required to achieve primary disinfection (e.g., chemical and/or UV disinfection system, coagulant dosing system, filters, etc.)
  - Equipment or processes necessary for maintaining secondary disinfection in the distribution system
  - Fluoridation system
- 3.3.5 Additional CCPs for the system are determined by evaluating and ranking the hazardous events for the remaining activities/process steps (i.e., those not included as OCWA’s minimum CCPs).
  - 3.3.6 Taking into consideration existing control measures (including the reliability and redundancy of equipment), each hazardous event is assigned a value for the likelihood and a value for the consequence of that event occurring based on the following criteria:



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-07  
Rev Date: 2022-09-14  
Rev No: 0  
Pages: 3 of 4

### RISK ASSESSMENT

Reviewed by: R. Marshall, QEMS Representative | Approved by: Y. Rondeau, SPC Manager

Value	Likelihood of Hazardous Event Occurring
1	<b>Rare</b> – Estimated to occur every 50 years or more (usually no documented occurrence at site)
2	<b>Unlikely</b> – Estimated to occur in the range of 10 – 49 years
3	<b>Possible</b> – Estimated to occur in the range of 1 – 9 years
4	<b>Likely</b> – Occurs monthly to annually
5	<b>Certain</b> – Occurs monthly or more frequently

Value	Consequence of Hazardous Event Occurring
1	<b>Insignificant</b> – Little or no disruption to normal operations, no impact on public health
2	<b>Minor</b> – Significant modification to normal operations but manageable, no impact on public health
3	<b>Moderate</b> – Potentially reportable, corrective action required, potential public health impact, disruption to operations is manageable
4	<b>Major</b> – Reportable, system significantly compromised and abnormal operations if at all, high level of monitoring and corrective action required, threat to public health
5	<b>Catastrophic</b> – Complete failure of system, water unsuitable for consumption

The likelihood and consequence values are multiplied to determine the risk value (ranking) of each hazardous event. Hazardous events with a ranking of 12 or greater are considered high risk.

3.3.7 Hazardous events and rankings are reviewed and any activity/process step is identified as an additional CCP if all of the following criteria are met:

- ✓ The associated hazardous event has a ranking of 12 or greater;
- ✓ The associated hazardous event can be controlled through control measure(s);
- ✓ Operation of the control measures can be monitored and corrective actions can be applied in a timely fashion;
- ✓ Specific control limits can be established for the control measure(s); and
- ✓ Failure of the control measures would lead to immediate notification to the Medical Officer of Health (MOH) and/or Ministry.

3.4 The outcomes of the risk assessment are documented as per OP-08 Risk Assessment Outcomes.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-07  
Rev Date: 2022-09-14  
Rev No: 0  
Pages: 4 of 4

### RISK ASSESSMENT

Reviewed by: R. Marshall, QEMS Representative | Approved by: Y. Rondeau, SPC Manager

3.5 At least once every calendar year, the QEMS Representative facilitates the verification of the currency of the information and the validity of the assumptions used in the risk assessment in preparation for the Management Review (OP-20). When performing this review, the following may be considered:

- Process/equipment changes
- Reliability and redundancy of equipment
- Emergency situations/service interruptions
- CCP deviations
- Audit/inspection results
- Changes to the Ministry document “Potential Hazardous Events for Municipal Residential Drinking Water Systems” (as amended)

#### 4. Related Documents

Ministry’s “Potential Hazardous Events for Municipal Residential Drinking Water Systems” (as amended)

Ministry’s “Procedure for Disinfection of Drinking Water in Ontario” (as amended)

OP-08 Risk Assessment Outcomes

OP-20 Management Review

#### 5. Revision History

Date	Revision #	Reason for Revision
2022-09-14	0	Procedure Issued



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-08  
Rev Date: 2022 09 14  
Rev No: 0  
Pages: 1 of 2

## RISK ASSESSMENT OUTCOMES

Reviewed by: R. Marshall, QEMS Representative | Approved by: Y. Rondeau, SPC Manager

### 1. Purpose

To document the outcomes of the risk assessment conducted as per OP-07 Risk Assessment.

### 2. Definitions

*Critical Control Point (CCP)* – An essential step or point in the subject system at which control can be applied by the Operating Authority to prevent or eliminate a drinking water health hazard or reduce it to an acceptable level

*Critical Control Limit (CCL)* – The point at which a Critical Control Point response procedure is initiated

### 3. Procedure

3.1 The QEMS Representative is responsible for updating the information in OP-08A Summary of Risk Assessment Outcomes as required.

3.2 The results of the risk assessment conducted as per OP-07 are documented in Table 1 of OP-08A. This includes:

- Identified potential hazardous events and associated hazards (possible outcomes) for each of the system's activities/process steps;  
Note: Hazards listed in the Ministry's "Potential Hazardous Events for Municipal Residential Drinking Water Systems" (as amended) are indicated in the appropriate column using the reference numbers in Table 4 of OP-08A.
- Identified control measures to address the potential hazards and hazardous events; and
- Assigned rankings for the hazardous events (likelihood x consequence = risk value) and whether the hazardous event is a Critical Control Point (CCP) (mandatory or additional).  
Note: If the hazardous event is ranked as 12 or higher and it is not being identified as a CCP, provide rationale as to why it does not meet the criteria set out in section 3.3.7 of OP-07).

3.3 Operations Management is responsible for ensuring that for each CCP:

- Critical Control Limits (CCLs) are set;
- Procedures and processes to monitor the CCLs are established; and
- Procedures to respond to, report and record deviations from the CCLs are implemented.

The identified CCPs, their respective CCLs and associated procedures are documented in Table 2 of OP-08A.

3.4 A summary of the results of the annual review/36-month risk assessment is recorded in Table 3 of OP-08A.





**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-08  
Rev Date: 2022 09 14  
Rev No: 0  
Pages: 2 of 2

**RISK ASSESSMENT OUTCOMES**

Reviewed by: R. Marshall, QEMS Representative | Approved by: Y. Rondeau, SPC Manager

3.5 Operations Management considers the risk assessment outcomes during the review of the adequacy of the infrastructure (Refer to OP-14 Review and Provision of Infrastructure).

**4. Related Documents**

- OP-07 Risk Assessment
- OP-08A Summary of Risk Assessment Outcomes
- OP-14 Review and Provision of Infrastructure
- Ministry's "Potential Hazardous Events for Municipal Residential Drinking Water Systems" (as amended)

**5. Revision History**

Date	Revision #	Reason for Revision
2022-09-14	0	Procedure issued



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 1 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

**Table 1 - Risk Assessment Table**

**Note:** Processes referred to in OP-07 Risk Assessment and OP-08 Risk Assessment Outcomes must be identified as mandatory Critical Control Points (CCPs) as applicable for all OCWA-operated facilities. Mandatory CCPs are not required to be ranked.

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
Source/Intake	2, 5, 6, 9	Spill of chemical material into Sasaginiga Lake (fuel from WTP generator)	Contamination of source water	Monitor and sample, online raw water pH, turbidity and temperature, Site specific Environmental Emergency Procedure (EEP) for Off-site Chemical/Fuel Spill, EEP for Contaminated Raw Water, Contingency Plan (CP) for Spill Response, CP for Unsafe Water	1	4	4	NO
Source/Intake	1, 2, 3, 6, 7	Collapse/blockage of intake pipe, Compromised structural integrity	Loss of water supply, unable to produce volume	Staff would take appropriate response measures - alternate intake pipe, Approx. 2 days supply from Tower and standpipe, Water ban and alternate source of water, Occasional inspections EEP for Water Supply Shortage	1	5	5	NO
Source/Intake	1, 3, 4, 9	Spring/fall turnover	Increased demand on process operations such as chemical optimization for changes in pH, alkalinity, temperature and turbidity.	Staff would keep higher alkalinity and make appropriate operational changes, Raw Water Turbidity Analyzer, Treated Water Turbidity Alarms, Chemical adjustments	4	2	8	NO



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 2 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
Source/Intake	1, 3, 10, 12	Algal Blooms	Biological contamination of raw water source	Weekly visual checks, SOP/Plan for Monitoring, Sampling and Reporting a Harmful Blue-Green Algae Bloom, Notifications from MOH, MECP and public	1	3	3	NO
Source/Intake	2,10	Flowmeter failure	Loss of Chemical feed	Alarmed, Plant shut down, Portable flow meter	1	1	1	NO
Low Lift Pumps	2, 7	Pump failures	Loss of water supply	Redundancy (2 pumps), Alarms, scheduled maintenance activities, Back-up generator for loss of power situations, EEP for Low Lift Pump Failure	3	2	6	NO
Air Compressor for all valves	2, 6, 7, 10	Compressor failure	Loss of water supply	Alarmed, Approx. 2 days' supply from Tower and standpipe, Back up compressor on site	3	1	3	NO
Filtration Process (includes flocculation, coagulation, dual media gravity filters) (primary disinfection)	10	Sodium Hydroxide Pump Failure (after filter and UV)	Lowered pH In Distribution System	Redundancy (1 back-up pump), Automatic switchover, Operator inspections, Scheduled maintenance activities, Chemical pump failure alarm and plant shut down, EEP for Chemical Pump Failure				YES – Mandatory CCP



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 3 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
<b>Filtration Process</b> (primary disinfection)	2, 10	Polymer feed pump failure	Increased turbidity, Ineffective removal of pathogens, Biological contamination	Redundancy (1 back-up pump), Automatic switchover, Operator inspections (tank levels, calculate dosage), Scheduled maintenance activities, Chemical pump failure alarm, EEP for Chemical Pump Failure, EEP for Reporting Adverse Water Quality, CP for Unsafe Water.				<b>YES – Mandatory CCP</b>
<b>Filtration Process</b> (primary disinfection)	2, 10	Filter breakthrough	Increased turbidity, Ineffective removal of pathogens, Potential for AWQI	On-line monitoring of filter effluent turbidity, Alarm on high turbidity, Redundancy (4 filters), Regular backwashes, Scheduled maintenance activities, Visual inspection of media, Plant shut down, EEP for Reporting Adverse Water Quality CP for Unsafe Water.				<b>YES – Mandatory CCP</b>
<b>Filtration Process</b> (primary disinfection)	10	Backwash system failure	Increased turbidity, Ineffective removal of pathogens, Potential for loss of treated water supply	Pump failure alarms, Two backwash pumps (redundancy), On-line monitoring, Scheduled maintenance activities, Alternate system for backwashing (manual)				<b>YES – Mandatory CCP</b>



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 4 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
				Lock filters and rinse with raw water (low lift), EEP for Backwash Failure, EEP for Reporting Adverse Water Quality, EEP for Water Supply Shortage, CP for Unsafe Water.				
<b>Filtration Process</b> (primary disinfection)	10	Turbidity analyzer failure	Unknown turbidity levels, Potential for AWQI	Filter redundancy (take filter out of service until analyzer replaced/repared), Scheduled maintenance activities, In-house readings, Operator inspections Alarm and lock out filters, EEP for Turbidity Analyzer Failure, EEP for Reporting Adverse Water Quality, CP for Unsafe Water.				<b>YES – Mandatory CCP</b>
<b>Filtration Process</b> (primary disinfection)	10	Backwash, effluent and filter to waste filter valve failures	Backwash failure, Loss of water, Inability to filter to waste	Regular maintenance, Alarms, Spare valve and parts.				<b>YES – Mandatory CCP</b>
<b>Ultra Violet (UV) Disinfection System</b> (primary disinfection)	10	UV System failure	Loss of disinfection, Potential biological contamination	Redundancy - 2 Trains (1 duty, 1 spare), Routine checks by operational staff, Monthly sensor checks by Instrumentation Technicians, Fail safe (automatic switch over on bulb or ballast failure and low dosage),				<b>YES – Mandatory CCP</b>



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 5 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
				Alarmed and plant shut down, Spare bulbs and parts on-site, EEP for Reporting Adverse Water Quality, CP for Unsafe Water.				
<b>Chlorination System</b> (primary disinfection)	10	Chlorine Gas Controller failure	Loss of disinfection, Potential biological contamination	Alarm and plant shut down, Redundancy, Scheduled maintenance activities, Manual operations, EEP for Vacuum Chlorinator Failure, EEP for Low or High Chlorine Residual in Treated Water, EEP for Reporting Adverse Water Quality, CP for Unsafe Water.				<b>YES – Mandatory CCP</b>
<b>Chlorination System</b> (primary disinfection)	10	Chlorine gas flowmeter failure	Loss of disinfection, Potential biological contamination	Alarmed/shut down – Chemical feed is pace to flow, EEP for Vacuum Chlorinator Failure, EEP for Low or High Chlorine Residual in Treated Water, EEP for Reporting Adverse Water Quality, CP for Unsafe Water.				<b>YES – Mandatory CCP</b>
<b>Chlorination System</b> (primary disinfection)	10	Chlorine gas feed pump failure	Loss of disinfection Low chlorine residual Inadequate inactivation of pathogens Potential for AWQI	Redundancy (1 main and 1 back-up pump), On-line monitoring with alarms/plant shut down, In-house residual testing and dosage calculations, Scheduled maintenance activities, Spare pump on site,				<b>YES – Mandatory CCP</b>



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 6 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
				EEP for Chlorine Gas Leak EEP for Reporting Adverse Water Quality, CP for Unsafe Water.				
<b>Chlorination System</b> (primary disinfection)	10, 11	Chlorine analyzer failure – unable to confirm CT	Unknown chlorine residual levels, Potential for AWQI	Low level Alarm/plant shut down, In-house residual testing, Scheduled maintenance activities, Back-up analyzer on-site, EEP for Chlorine Analyzer Failure EEP for Reporting Adverse Water Quality, CP for Unsafe Water.				<b>YES – Mandatory CCP</b>
<b>Chlorination System</b> (primary disinfection)	2, 3, 10	Low supply of chlorine gas	Inadequate disinfection, Potential for AWQI	Operator checks, Auto switch over, Always 2 months supply on-site, EEP for Reporting Adverse Water Quality, CP for Unsafe Water.				<b>YES – Mandatory CCP</b>
<b>Standpipe Off-line</b> (primary disinfection)	10	Coleman Flowmeter Failure – unable to confirm CT	Biological contamination, Potential for AWQI	Alarmed/plant shut down – max limit 18 L/s, EEP for Reporting Adverse Water Quality.				<b>YES – Mandatory CCP</b>
<b>Standpipe Off-line</b> (primary disinfection)	10, 11	Coleman Chlorine Analyzer Failure – unable to confirm CT	Biological contamination, Potential for AWQI	Alarmed/plant shut down, EEP for Chlorine Analyzer Failure, EEP for Reporting Adverse Water Quality, CP for Unsafe Water.				<b>YES – Mandatory CCP</b>



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 7 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
High Lift Pumps	2, 7	High lift pump failures	Low pressure in distribution system, Possible contamination due to infiltration	Redundancy (2 pumps), Scheduled maintenance activities, Operational control, On-line monitoring of discharge pressure, Alarms for low pressure, Tower as a back-up for pressure and supply, Back-up generator for loss of power situations, EEP for High Lift Pump Failure, EEP for Low or Loss of Pressure Events in the Distribution System	3	1	3	NO
Stand Pipe	1, 2, 3, 7	Loss of standpipe due to collapse, break, leak etc.	Inability to backwash, Water supply shortage,	Low level alarm, Tower or standpipe can be bypassed and still meet CT, SOP for CT when Standpipe Off-line, CT Spreadsheet, EEP for Water Supply Shortage.	1	1	1	NO
Stand Pipe	2	Standpipe out of service for repair, maintenance	Low/loss of water supply	Supply water from tower, Scheduled controlled maintenance plan, SOP for CT when Standpipe Off-line, CT Spreadsheet, EEP for Water Supply Shortage.	1	4	4	NO
Tower	1, 2, 3, 7	Loss of tower due to collapse, break, leak etc.	Loss of pressure to the distribution, Contamination,	Low level alarm, Tower can be bypassed to supply Town,	1	4	4	NO





# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 8 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
			Loss of treated water supply, Inadequate fire protection, Inability to backwash	Town ordered water conservation or ban (alternate source of water), EEP for Water Supply Shortage.				
<b>Tower</b>	2	Tower out of service for repair, maintenance	Low/loss of water supply, Lowered firefighting capability	Supply water from standpipe, Scheduled controlled maintenance plan.	2	3	6	<b>NO</b>
<b>Water Treatment System/Plant</b>	2, 3, 6, 7, 10, 11	Fire in Plant or at Tower (accidentally or intentionally)	Partial or full shutdown, Potential loss of service and water supply, Damage to SCADA and critical equipment	Regular operator visits, Alarms, Fire extinguishers, EEP for Fire in Plant	1	5	5	<b>NO</b>
<b>Water Treatment System/Plant</b>	1, 2, 3, 4, 6, 10	Power failure due to weather or vandalism/terrorism	Loss of treated water supply, Potential loss of equipment	Back-up diesel generator, Scheduled maintenance activities for back-up generator, Power failure alarm, EEP for Hydro Interruption, EEP for Power Failure of Long Duration	1	1	1	<b>NO</b>
<b>Water Treatment System/Plant</b>	1, 2, 3, 4, 6, 10	Standby generator failure (accidentally or vandalism/terrorism)	Loss of treated water supply, Potential loss of equipment	Power failure alarm, Scheduled maintenance activities, Portable generator available within the NEO Hub (within 4-8 hours), Genset low fuel level alarm, Tower (Back up supply), EEP for Standby Power Failure, CP for Loss of Service	1	5	5	<b>NO</b>



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 9 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
Water Treatment System/Plant	6, 10, 11	Vandalism/terrorism	Contamination of the water supply, Damage to critical equipment	Locked (water plant), Intrusion alarms on doors and windows  Appropriate signage and lighting, Visited frequently by operational staff, Cameras, remote monitoring of cameras on phone, Fenced, Water conservation or ban (alternate source of drinking water), EEP for Vandalism or Suspected Unauthorized Entry, EEP for Contamination of Treated Water, EEP for Water Supply Shortage, CP for Spill, Response, CP for Loss of Service, CP for Security Breach	1	5	5	NO
Water Treatment System/Plant	1	Pandemic	Shortage of staff, Supply shortages, Loss of sampling locations	OCWA's Emergency Operations Center/Action Group (EOC), Staff isolation, staff rescheduling, modifications to work rounds, remote work done where possible, Alternate suppliers available, to Essential Services & Suppliers List, CP for Critical Shortage of Staff	3	2	6	NO
Water Treatment System/Plant	13	Cybersecurity threats	Loss of system process visibility for operators (e.g., unable to monitor treatment processes)	Embedded system security include: Implementing Identity and Access Management throughout the account management lifecycle. Privileges are	2	4	8	NO



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 10 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
			<p>Interruption of data recording leading to a loss of critical/compliance data</p> <p>Inability to remotely control processes and/or loss of automatic control</p> <p>installation of malicious programs like ransomware, which can disable business enterprise until money is paid</p> <p>Loss of data (stolen or maliciously deleted)</p>	<p>granted to users with two principles – need to know and least privileges. Users are assigned only the privileges they need to perform their job.</p> <p>Employing default to fail secure. The application or system failure will cause little or no harm to other systems. Data will not fall into the wrong hands.</p> <p>Applying multiple layers of defense including:</p> <ul style="list-style-type: none"> <li>o Intrusion detection systems constantly monitoring traffic flow (borders)</li> <li>o Multi factor authentication</li> <li>o Firewalls that provide real-time filtering and blocking (walls)</li> <li>o Cryptography and layered authentication (zones)</li> <li>o Certified professionals ensuring system integrity (gatekeepers)</li> </ul> <p>Constant monitoring and tracking for quick and effective response to attacks</p> <p>Perform routine vulnerability scans and threat assessments</p> <p>Carry out periodic cyber security audits and risk compliance checks</p>				
<b>Water Treatment System/Plant</b>	1, 2, 3, 4, , 9, 10, 11	Natural Disasters (ice storm, wind storm, flooding, forest fire)	Loss of supply, Loss of communication, Loss of power	Contingency Plans, Emergency Procedures, OCWA's Emergency Response Plan, City's Emergency Response Plan,	2	4	8	<b>NO</b>



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 11 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
				Staff training.				
Distribution System (secondary disinfection)	11	Loss of residual in distribution system	Failure to control biofilm and pathogens (long term), Potential AWQI	Continuous on-line monitoring of chlorine residual into the distribution system, System-wide residual testing twice weekly, Regulatory scheduled maintenance, Alarms for low/high chlorine residual in water entering distribution system, EEP for Reporting Adverse Water Quality, CP for Unsafe Water				<b>YES – Mandatory CCP</b>
Distribution System	1, 3, 4, 11	Adverse Water Quality Result as described in O. Reg. 170/03	Potential for unsafe drinking water	Site specific Sampling Schedule, EEP for Reporting Adverse Water Quality, CP for Unsafe Water.	3	4	12	<b>NO</b> – does not meet all criteria in step 3.3.7 of OP-07. No control of the hazard
Distribution System (watermains)	1, 2, 3, 4, 6, 7, 8	Structural failure due to accident, weather or age	Contamination, loss of pressure, Loss of pressure/supply, Road damage	Notification/complaints from consumers, Routine monitoring of flows, standpipe and tower levels, Alarms (high flows, low pressure, low standpipe or tower levels), Maintenance program, AWWA Standards and Ministry's Watermain Disinfection Procedure, EEP for Low or Loss of Pressure, EEP for Water Supply Shortage,	3	3	9	<b>NO</b>



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 12 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
				EEP for Reporting Adverse Water Quality, CP for Unsafe Water.				
Distribution System (valves)	2, 7, 11	Structural failure due to accident, weather or age	Loss of control, Contamination, Loss of pressure	Planned Maintenance, Routine monitoring of flows, standpipe and tower levels, Maintenance program - valve cycling, Notification/complaints from consumers, AWWA Standards and Ministry's Watermain Disinfection Procedure, EEP for Low or Loss of Pressure, EEP for Reporting Adverse Water Quality, CP for Unsafe Water	3	1	3	
Distribution System (hydrants)	2, 7, 11	Structural failure/ component failure	Loss of service pressure	Customer notification/complaints, Planned Maintenance, Routine monitoring of flows, standpipe and tower levels, Alarms (high flows, low pressure, low tower), Inspection and maintenance program, Isolate, EEP for Low or Loss of Pressure, EEP for Water Supply Shortage EEP for Reporting Adverse Water Quality, CP for Unsafe Water	3	1	3	



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 13 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
<b>Distribution System</b> (service connections)	8	Cross-connection, backflow, siphonage	Contamination	Consumer notification/complaints, Distribution system microbiological testing, Municipal by-law, EEP for Reporting Adverse Water Quality, CP for Unsafe Water	1	4	4	<b>NO</b>
<b>Distribution System</b> (service connections)	1, 2, 3, 4, 6, 7, 8	Structural failure/breaks	Contamination, Loss of pressure or supply to affected users	Consumer notification/complaints EEP for Reporting Adverse Water Quality, CP for Unsafe Water	3	3	9	<b>NO</b>
<b>Distribution System</b> All - watermains, connections, valves, construction, etc.	2, 6, 7, 8	Accident, Vandalism/terrorism	Contamination, Loss of water supply, Loss of pressure	Notifications/complaints from customers, On-line monitoring of flows, pressure and tower levels Alarms (low pressure, low standpipe low tower), Operator checks, EEP for Low or Loss of Pressure, EEP for Water Supply Shortage, EEP for Reporting Adverse Water Quality, CP for Unsafe Water.	3	3	9	<b>NO</b>
<b>Distribution System</b> (maintain system pressure)	1, 2, 3, 4, 6, 7	Major fire	Contamination, Loss of pressure	Emergency management, Communication with fire department, Redundancy; 2 high lift pumps, Monitoring of flows, pressure, and tower levels,	3	3	9	<b>NO</b>



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 14 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Activity/ Process Step	MECP Potential Hazardous Event/Hazard Reference # (see Table 3)	Description of Hazardous Event	Possible Outcome (Hazards)	Existing Control Measures	Likelihood	Consequence	Risk Value	CCP?
				Tower (water Supply), EEP for Low or Loss of Pressure, EEP for Water Supply Shortage, EEP for Reporting Adverse Water Quality, CP for Unsafe Water				
<b>Distribution System</b> Flushing (clean piping, remove accumulation)	11	Failure to flush	Contamination	Maintenance program (bi-annual flushing, Procedures for flushing, Staff training,	3	2	6	<b>NO</b>
<b>Distribution System</b> (new construction)	11	Sub-standard construction and/or commissioning	Contamination, Loss of Pressure	AWWA guidelines, Ministry's Watermain Disinfection Procedure, Provincial Standards Staff training, Sampling and testing	1	4	4	<b>NO</b>



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Doc: OP-08A  
 Rev Date: 2024-07-08  
 Rev No: 3  
 Pages: 15 of 19

## SUMMARY OF RISK ASSESSMENT OUTCOMES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

**Table 2 - Identified Critical Control Points (CCPs)**

CCP	Critical Control Limits	Monitoring Procedures	Response, Reporting and Recording Procedures
<b>Filtration Process</b> (for Primary Disinfection)	<b>Filter Effluent Turbidity Alarms (Filters 1-4)</b> High set point = 0.7 NTU (filter shutdown) High High set point = 1.0 NTU (CCL) Automatic backwash at 0.3 NTU  <b>Sodium Hydroxide and PAC Feed Systems</b> If both pumps fail an alarm is initiated and the plant shuts down	<ul style="list-style-type: none"> <li>• SCADA (continuous online analyzers)</li> <li>• Operator checks including dosage calculations</li> <li>• Redundancy (4 filters)</li> <li>• Trend review and sign-off as per O. Reg. 170/03</li> </ul>	Refer to: <ul style="list-style-type: none"> <li>• EEP for High Turbidity</li> <li>• EEP for Turbidity Analyzer Failure</li> <li>• EEP for Chemical Pump Failure</li> <li>• EEP for Backwash Failure (Filters)</li> <li>• EEP for Reporting Adverse Water Quality</li> <li>• CP for Unsafe Water</li> </ul>
<b>Chlorine Gas System</b> (for Primary Disinfection)	<b>Treated Water Free Chlorine Residual Alarms &amp; Plant Shutdown</b> Low set point = no less than 1 mg/L (plant shut down) High set point = 3.50 mg/L	<ul style="list-style-type: none"> <li>• SCADA (continuous online analyzers)</li> <li>• Daily operator checks via remote monitoring system,</li> <li>• Routine on-site checks by operation staff,</li> <li>• Dosage calculations,</li> <li>• Trend review and sign-off as per O. Reg. 170/03,</li> <li>• Sampling</li> </ul>	Refer to: <ul style="list-style-type: none"> <li>• SOP for CT (Chlorine Concentration x Time)</li> <li>• Site Specific CT Spreadsheet to calculate CT</li> <li>• EEP for High or Low Chlorine Residual</li> <li>• EEP for Vacuum Chlorinator Failure</li> <li>• EEP for Chlorine Gas Leak</li> <li>• EEP for Chlorine Cylinder Repair Kit</li> <li>• EEP for Reporting Adverse Water Quality</li> <li>• CP for Unsafe Water</li> </ul>
<b>Ultra Violet (UV) System</b> (for Primary Disinfection)	<b>UV Dosage Alarm &amp; Plant Shutdown</b> Low set point = 40 mj/cm <sup>2</sup> (switchover to standby unit. If both fail, system shuts down)	<ul style="list-style-type: none"> <li>• SCADA (continuous online analyzers)</li> <li>• Daily operator checks via remote monitoring system,</li> <li>• Dosage calculations,</li> <li>• Routine on-site checks by operation staff,</li> </ul>	When a UV alarm is activated, the operator shall check to make sure the stand by UV is activated. If the standby unit fails the system shuts down and no water enters the standpipe. Refer to: <ul style="list-style-type: none"> <li>• SOP for CT (Chlorine Concentration x Time)</li> <li>• CT Spreadsheet to calculate CT</li> </ul>





**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Doc: OP-08A  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 16 of 19

**SUMMARY OF RISK ASSESSMENT OUTCOMES**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

CCP	Critical Control Limits	Monitoring Procedures	Response, Reporting and Recording Procedures
		<ul style="list-style-type: none"> <li>Trend review and sign-off as per O. Reg. 170/03</li> </ul>	<ul style="list-style-type: none"> <li>EEP for Reporting Adverse Water Quality</li> <li>CP for Unsafe Water</li> </ul>
<b>Standpipe</b> (for Primary Disinfection)	<b>Standpipe Level Alarm &amp; Plant Shutdown</b> Low set point = 2.5 m CCL – 1 m	<ul style="list-style-type: none"> <li>SCADA (continuous online analyzers)</li> <li>Daily operator checks</li> <li>Trend review and sign-off as per O. Reg. 170/03</li> </ul>	Refer to: <ul style="list-style-type: none"> <li>SOP for CT</li> <li>CT Spreadsheet to calculate CT</li> <li>EEP for Low Standpipe Level</li> <li>EEP for Water Supply Shortage</li> <li>CP for Unsafe Water</li> </ul>
<b>Secondary Disinfection</b>	<b>Free Chlorine Residual - Distribution</b> Low = 0.05 mg/L (regulatory limit) High = 4.0 mg/L (operational high)	Distribution chlorine residuals monitored as per O. Reg. 170/03	Refer to: <ul style="list-style-type: none"> <li>EEP for Reporting Adverse Water Quality,</li> <li>CP for Unsafe Water</li> </ul>



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Doc: OP-08A  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 17 of 19

**SUMMARY OF RISK ASSESSMENT OUTCOMES**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

**Table 3:** Potential Hazardous Event/Hazard Reference Numbers (based on the Ministry’s “Potential Hazardous Events for Municipal Residential Drinking Water Systems” dated April 2022)

If the hazardous event/hazard is not applicable to this drinking water system (DWS), it will be noted in the first column of this table.

System Type (indicate all that apply to this DWS)		Reference Number	Description of Hazardous Event/Hazard
X	All Systems	1	Long Term Impacts of Climate Change
X	All Systems	2	Water supply shortfall
X	All Systems	3	Extreme weather events (e.g., tornado, ice storm)
X	All Systems	4	Sustained extreme temperatures (e.g., heat wave, deep freeze)
X	All Systems	5	Chemical spill impacting source water
X	All Systems	6	Terrorist and vandalism actions
X	Distribution Systems	7	Sustained pressure loss
X	Distribution Systems	8	Backflow
X	Treatment Systems	9	Sudden changes to raw water characteristics (e.g., turbidity, pH)
X	Treatment Systems	10	Failure of equipment or process associated with primary disinfection (e.g., coagulant dosing system, filters, UV system, chlorination system)
X	Treatment Systems and Distribution Systems providing secondary disinfection	11	Failure of equipment or process associated with secondary disinfection (e.g., chlorination equipment, chloramination equipment)
X	Treatment Systems using Surface Water	12	Algal blooms
X	All Systems	13	Cybersecurity threats



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Doc: OP-08A  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 18 of 19

**SUMMARY OF RISK ASSESSMENT OUTCOMES**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

**Table 4 - Record of Annual Review/36-Month Risk Assessment**

The Drinking Water Quality Management Standard (DWQMS) requires that the currency of the information and the validity of the assumptions used in the risk assessment be verified at least once a year. In addition, the risk assessment must be conducted at least once every thirty-six months. Refer to OP-07 and OP-08.

Date of Activity	Type of Activity	Participants	Summary of Results
2022-09-12	Risk Assessment	R. Marshall (PCT), J. Dubois (ORO), V. Legault (Sr. Ops Manager)	Risk assessment conducted
2023-08-17	Annual Review	Ilona Bruneau (PCT)	<p>Table 1 – changed Adverse Reporting Procedures to new updated procedure that captures all adverse water quality incidents. Added spring and fall turnover as a hazard for the source water. Added procedures and contingency plans to selected hazards. Change Risk Value for AWQI results from 9 to 12. Added stand pipe and tower out of service for repair or maintenance as potential hazards. Updated distribution system hazards and made minor formatting changes.</p> <p>Table 2 – Updated Response, Reporting and Recording procedures for the filtration process, chlorine gas system and standpipe.</p>
2023-08-24	Annual Review of Critical Control Points	Bryce Logan, Operations Supervisor/ORO	Table 2 - Updated critical control limits as per review during internal audit. Changed high set point for chlorine from 4.0 to 3.5 mg/L, removed 2 minute delay for automatic backwash and changed low standpipe level set point to 2.5 from 4.0 m
2024-07-05	Annual Review	Ilona Bruneau (PCT)	<p>Table 1 – Updated control measures for algal blooms. Added procedures for Reporting Adverse Water Quality and Unsafe Water to selected hazards under the filtration process, added the procedure for Water Supply Shortage under standpipe hazards. Added partial or full loss of equipment to fire in plant and added fire extinguishers as a control measure.</p> <p>Table 2 added procedure for Backwash Failure for the filtration process and Chlorine Cylinder Repair Kit for the chlorine gas system.</p>



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Doc: OP-08A  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 19 of 19

**SUMMARY OF RISK ASSESSMENT OUTCOMES**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

**Revision History**

<b>Date</b>	<b>Revision</b>	<b>Description of Revision</b>
2022-09-12	0	Risk assessment conducted
2022-10-21	1	Added information under "CCP" column where it had been omitted
2023-10-11	2	Revised summary based on results of August 17 and August 24, 2023 reviews.
2024-07-08	3	Revised summary based on results of July 5, 2024 review.



# OPERATIONAL PLAN

## Cobalt Drinking Water Systems

QEMS Proc.: OP-09  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 1 of 8

### ORGANIZATIONAL STRUCTURE, ROLES, RESPONSIBILITIES AND AUTHORITIES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

## 1. Purpose

To document the following for the Cobalt Drinking Water Systems:

- Owner;
- Organizational structure of the Operating Authority;
- QEMS roles, responsibilities and authorities of staff, Top Management and individuals/groups that provide corporate oversight; and
- Responsibilities for conducting the Management Review

## 2. Definitions

*Operations Management* – refers to the Senior Operations Manager and/or Operations Manager that directly oversees a facility’s operations

*Senior Leadership Team (SLT)* – members include President and CEO, Executive Vice President and General Counsel, Vice Presidents of OCWA’s business units and Regional Hub Managers

*Top Management* – a person, persons or a group of people at the highest management level within an operating authority that makes decisions respecting the QMS and recommendations to the owner respecting the subject system or subject systems

*Operations Personnel* – Employees of the drinking water system who perform various activities related to the compliance, operations and maintenance of the drinking water system that may directly affect drinking water quality

## 3. Procedure

### 3.1 Organizational Structure

The Cobalt Drinking Water System is owned by the Corporation of the Town of Cobalt, represented by the Mayor, Town Manager and Council.

The organizational structure of OCWA, the Operating Authority, is outlined in appendix OP-09A: Organizational Structure.

### 3.2 Top Management

Top Management for the Cobalt Drinking Water System consists of:

- Operations Management – Temiskaming Shores Cluster
- Regional Hub Manager – Northeastern Ontario Regional Hub
- Operations Management, Capital Projects – Northeastern Ontario Regional Hub
- Safety, Process & Compliance Manager – Northeastern Ontario Regional Hub



# OPERATIONAL PLAN

## Cobalt Drinking Water Systems

QEMS Proc.: OP-09  
 Rev Date: 2024-07-08  
 Rev No: 2  
 Pages: 2 of 8

### ORGANIZATIONAL STRUCTURE, ROLES, RESPONSIBILITIES AND AUTHORITIES

Reviewed by: I. Bruneau, QEMS Representative | Approved by: B. Logan, Operations Manager

Irrespective of other duties (see Table 9-2 below), Top Management’s responsibilities and authorities include:

- Endorsing the Operational Plan as per the Commitment and Endorsement procedure (OP-03);
- Ensuring that the QEMS meets the requirements of the DWQMS;
- Ensuring staff are aware of the applicable legislative and regulatory requirements;
- Communicating the QEMS according to the Communications procedure (OP-12);
- Providing resources needed to maintain and continually improve the QEMS;
- Appointing and authorizing a QEMS Representative (OP-04); and
- Undertaking Management Reviews as per the Management Review procedure (OP-20).

Note: Specific responsibilities of the individual members of Top Management are identified in the referenced procedures.

### 3.3 Corporate Oversight

Roles, responsibilities and authorities for individuals/groups providing corporate oversight of OCWA’s QEMS are summarized in Table 9-1 below.

**Table 9-1: Corporate QEMS Roles, Responsibilities and Authorities**

Role	Responsibilities and Authorities
Board of Directors	<ul style="list-style-type: none"> <li>• Set the Agency’s strategic direction, monitor overall performance and ensure appropriate systems and controls are in place in accordance with the Agency’s governing documents</li> <li>• Review and approve the QEMS Policy</li> </ul>
Senior Leadership Team (SLT)	<ul style="list-style-type: none"> <li>• Establish the Agency’s organizational structure and governing documents and ensure resources are in place to support strategic initiatives</li> <li>• Monitor and report on OCWA’s operational and business performance to the Board of Directors</li> <li>• Review the QEMS Policy and recommend its approval to the Board</li> <li>• Approve corporate QEMS programs and procedures</li> </ul>
Corporate Compliance	<ul style="list-style-type: none"> <li>• Manage the QEMS Policy and corporate QEMS programs and procedures</li> <li>• Provide support for the local implementation of the QEMS</li> <li>• Monitor and report on QEMS performance and any need for improvement to SLT</li> <li>• Consult with the MECP and other regulators and provide compliance support/guidance on applicable legislative, regulatory and policy requirements</li> <li>• Manage contract with OCWA’s DWQMS accreditation body</li> </ul>



**OPERATIONAL PLAN**  
Cobalt Drinking Water Systems

QEMS Proc.: OP-09  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 3 of 8

**ORGANIZATIONAL STRUCTURE, ROLES, RESPONSIBILITIES AND AUTHORITIES**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

3.4 Regional Hub Roles, Responsibilities and Authorities

QEMS roles, responsibilities and authorities of Northeastern Ontario Regional Hub personnel are summarized in Table 9-2 below. This information is kept current as per the Document and Records Control procedure (OP-05) and is communicated to staff as per the Communications procedure (OP-12).

Additional duties of employees are detailed in their job specifications and in the various QEMS programs and procedures that form, or are referenced in, this Operational Plan.

**Table 9-2: QEMS Roles, Responsibilities and Authorities for the Regional Hub**

Role/Position	Responsibilities and Authorities
All Operations Personnel	<ul style="list-style-type: none"> <li>• Perform duties in compliance with applicable legislative and regulatory requirements</li> <li>• Be familiar with the QEMS Policy and work in accordance with QEMS programs and procedures</li> <li>• Maintain operator certification (as required)</li> <li>• Attend/participate in training relevant to their duties under the QEMS</li> <li>• Document all operational activities</li> <li>• Identify potential hazards at their facility that could affect the environmental and/or public health and report to Operations Management</li> <li>• Report and act on all operational incidents</li> <li>• Recommend changes to improve the QEMS</li> </ul>
Regional Hub Manager (Top Management)	<ul style="list-style-type: none"> <li>• Oversee the administration and delivery of contractual water/wastewater services on a Regional Hub level</li> <li>• Fulfill role of Top Management</li> <li>• Ensure corporate QEMS programs and procedures are implemented consistently throughout the Regional Hub</li> <li>• Manages the planning of training programs for Regional Hub</li> <li>• Report to VP of Operations/SLT on the regional performance of the QEMS and any need for Agency-wide improvement</li> </ul>
Operations Management, Capital Projects (Top Management)	<ul style="list-style-type: none"> <li>• Provide support to the regional operations teams related to planning and execution of capital projects.</li> <li>• Develop standard processes to provide efficiency when providing capital project related support to clients (internal/external)</li> <li>• Report to the Regional Hub Manager on regional capital project status'</li> <li>• Prepare and manage project budgets, ensuring cost-effectiveness</li> <li>• Develop detailed project plans, including timelines, budgets and resource allocation.</li> </ul>
Operations Management (Top Management)	<ul style="list-style-type: none"> <li>• Manage the day-to-day operations and maintenance of his/her assigned facilities and supervise facility operational staff</li> </ul>



Ontario Clean Water Agency

# OPERATIONAL PLAN

Cobalt Drinking Water Systems

QEMS Proc.: OP-09  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 4 of 8

## ORGANIZATIONAL STRUCTURE, ROLES, RESPONSIBILITIES AND AUTHORITIES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

Role/Position	Responsibilities and Authorities
	<ul style="list-style-type: none"> <li>• Fulfill role of Top Management</li> <li>• Ensure corporate and site-specific QEMS programs and procedures are implemented at his/her assigned facilities</li> <li>• Determine necessary action and assign resources in response to operational issues</li> <li>• Report to the Regional Hub Manager on facility operational performance</li> <li>• Ensure operational training is provided for the cluster (in consultation with the SPC Manager as required)</li> <li>• May act as Overall Responsible Operator (ORO) when required if holds appropriate certification – same class or higher than the class of the water treatment or water distribution subsystem</li> <li>• May act as alternate ORO if the designated ORO is unable to act when required, if holds applicable certification or if the certification is not more than one class lower than the class of the subsystem and for not more than 150 days in any 12 month period.</li> <li>• Refer to ORO Letter</li> </ul>
<p>Safety, Process &amp; Compliance (SPC) Manager (Top Management)</p>	<ul style="list-style-type: none"> <li>• Supervise facility compliance staff and provide technical and program support to the Regional Hub related to process control and compliant operations</li> <li>• Fulfill role of Top Management</li> <li>• Ensure corporate/regional QEMS programs and procedures are implemented consistently throughout the Regional Hub</li> <li>• Assist in the development of site-specific operational procedures as required</li> <li>• Ensure training on applicable legislative and regulatory requirements and the QEMS is provided for the Regional Hub (in consultation with Operations Management as required)</li> <li>• Monitor and report to the Regional Hub Manager and Operations Management on the compliance status and QEMS performance within his/her Regional Hub and any need for improvement</li> <li>• Act as alternate QEMS Representative (when required)</li> </ul>
<p>Process &amp; Compliance Technician - PCT (QEMS Representative)</p>	<ul style="list-style-type: none"> <li>• Implement, monitor and support corporate programs relating to environmental compliance and support management by evaluating and implementing process control systems at his/her assigned facilities</li> <li>• Fulfill role of QEMS Representative (OP-04)</li> <li>• Monitor, evaluate and report on compliance/quality status of his/her assigned facilities</li> <li>• Implement facility-specific QEMS programs and procedures consistently at his/her assigned facilities</li> <li>• Participate in audits and inspections and assist in developing, implementing and monitoring action items to respond to findings</li> <li>• Report to the SPC Manager on QEMS implementation and identify</li> </ul>





Ontario Clean Water Agency

# OPERATIONAL PLAN

Cobalt Drinking Water Systems

QEMS Proc.: OP-09  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 5 of 8

## ORGANIZATIONAL STRUCTURE, ROLES, RESPONSIBILITIES AND AUTHORITIES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

Role/Position	Responsibilities and Authorities
	<p>the need for additional/improved processes and procedures at the regional/cluster/facility level (in consultation with the Operations Management as required)</p> <ul style="list-style-type: none"> <li>• Communicates to Owners on facility compliance and DWQMS accreditation as directed</li> <li>• Deliver/participate in/coordinate training including applicable legislative and regulatory requirements and the QEMS</li> <li>• May fulfil role of Certified Operator when required (based on certification)</li> </ul>
<p>Operations Supervisor Water &amp; Wastewater</p>	<ul style="list-style-type: none"> <li>• Perform duties as assigned by Operations Management</li> <li>• Leads daily plant operations and maintenance activities by assigning and monitoring work and resolving issues</li> <li>• Directly supervises projects, provides direction and supervision to operations/mechanical staff, contractors and consultants</li> <li>• Participate as a technical advisor to staff and management and provide specialized training on technical issues</li> <li>• Oversee maintenance activities on equipment and process in order to maintain compliance with applicable legislation, regulations, approvals, and established procedures</li> <li>• Identifies asset management needs and assist management by providing recommendations for annual capital forecasts and</li> <li>• Gathers information for operational and regulatory reports as required</li> <li>• Monitors and reviews water quality test results</li> <li>• Assist in the preparation of facility manuals and documenting operating processes and procedures for staff</li> <li>• Assist in the procurement, RFQ and RFP process</li> <li>• Act for management during vacations or periodic absences</li> <li>• Perform duties of Operator/Mechanic as required</li> <li>• May act as Operator-in-Charge (OIC) if holds a Class I or higher certification for a water treatment or water distribution subsystem</li> <li>• May act as Overall Responsible Operator (ORO) if holds appropriate certification – same class or higher than the class of the water treatment or water distribution subsystem</li> <li>• May act as alternate ORO if the designated ORO is unable to act when required, if holds applicable certification or if the certification is not more than one class lower than the class of the subsystem and for not more than 150 days in any 12 month period.</li> <li>• Refer to ORO Letter</li> </ul>
<p>Certified Operator</p> <p>Includes the following positions:</p> <ul style="list-style-type: none"> <li>• Senior Water &amp;</li> </ul>	<ul style="list-style-type: none"> <li>• Perform duties as assigned by Operations Management or Supervisor</li> <li>• Monitor, maintain and operate facilities in accordance with applicable regulations, approvals and established operating procedures</li> </ul>



Ontario Clean Water Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water Systems

QEMS Proc.: OP-09  
 Rev Date: 2024-07-08  
 Rev No: 2  
 Pages: 6 of 8

### ORGANIZATIONAL STRUCTURE, ROLES, RESPONSIBILITIES AND AUTHORITIES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

Role/Position	Responsibilities and Authorities
<p>Wastewater Operator</p> <ul style="list-style-type: none"> <li>• Water &amp; Wastewater Operator</li> <li>• Water &amp; Wastewater Operator-In-Training (OIT)</li> </ul>	<ul style="list-style-type: none"> <li>• Collect samples and perform laboratory tests and equipment calibrations as required</li> <li>• Regularly inspect operating equipment, perform routine preventive maintenance and repairs and prepare and complete work orders as assigned</li> <li>• Assist management in providing recommendations for annual capital forecasts and gathering information for operational reports as required</li> <li>• Assist in the review and preparation of facility manuals and operating procedures</li> <li>• Ensure records of adjustments made to the process under their responsibility, equipment operating status during their shifts and any departures from normal operations observed and actions taken are maintained within facility logs/record keeping mechanisms (as per O. Reg. 128)</li> <li>• Participate in facility inspections and audits</li> <li>• May act as Operator-in-Charge (OIC) if holds a Class I or higher certification for a water treatment or water distribution subsystem</li> <li>• May act as Overall Responsible Operator (ORO) if holds appropriate certification – same class or higher than the class of the water treatment or water distribution subsystem</li> <li>• May act as alternate ORO if the designated ORO is unable to act when required, if holds applicable certification or if the certification is not more than one class lower than the class of the subsystem and for not more than 150 days in any 12 month period.</li> <li>• Refer to ORO Letter</li> </ul> <p><b>NOTE:</b> OITs cannot act as OIC and/or ORO. OITs perform the above duties under the direction of the OIC/ORO and as assigned by Operations Management or designate.</p>
<p>Instrumentation Technician (UPIT)/SCADA Support/Operator</p>	<ul style="list-style-type: none"> <li>• Provide advice and technical expertise on the services required for process control and automation systems</li> <li>• Discuss and advise on detailed system and programming requirements, modify existing and new software in response to plant requests, analyze and resolve problems/error conditions, document changes/modifications and configure, install and support related software, hardware and network for such systems</li> <li>• Perform repairs, inspections, calibrations, preventive maintenance and/or scheduled maintenance on electrical systems, equipment, components and devices in accordance with established procedures and record the maintenance data</li> <li>• Monitor facility processes through visual inspection, the SCADA system or by taking readings from the process control equipment</li> <li>• Operate and adjust equipment/processes to maintain compliance with applicable legislation, regulations, approvals and established operating procedures</li> </ul>



Ontario Clean Water Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water Systems

QEMS Proc.: OP-09  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 7 of 8

### ORGANIZATIONAL STRUCTURE, ROLES, RESPONSIBILITIES AND AUTHORITIES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

Role/Position	Responsibilities and Authorities
	<ul style="list-style-type: none"> <li>• Install and commission new electrical/electronic equipment and automation systems</li> <li>• Performs duties as described under “Certified Operator”</li> <li>• May act as Operator-in-Charge (OIC) if holds a Class I or higher certification for a water treatment or water distribution subsystem</li> <li>• May act as Overall Responsible Operator (ORO) if holds appropriate certification – same class or higher than the class of the water treatment or water distribution subsystem</li> <li>• May act as alternate ORO if the designated ORO is unable to act when required if holds applicable certification or if the certification is not more than one class lower than the class of the subsystem and for not more than 150 days in any 12 month period.</li> <li>• Refer to ORO Letter</li> </ul>
<p>Electronics Technician/Operator</p>	<ul style="list-style-type: none"> <li>• Perform repairs, inspections, calibrations, preventive maintenance and/or scheduled maintenance on electrical systems, equipment, components and devices in accordance with established procedures and record the maintenance data</li> <li>• Monitor facility processes through visual inspection, the SCADA system or by taking readings from the process control equipment</li> <li>• Operate and adjust equipment/processes to maintain compliance with applicable legislation, regulations, approvals and established operating procedures</li> <li>• Performs duties as described under “Certified Operator”</li> <li>• May act as Operator-in-Charge (OIC) if holds a Class I or higher certification for a water treatment or water distribution subsystem</li> <li>• May act as Overall Responsible Operator (ORO) if holds appropriate certification – same class or higher than the class of the water treatment or water distribution subsystem</li> <li>• May act as alternate ORO if the designated ORO is unable to act when required if holds applicable certification or if the certification is not more than one class lower than the class of the subsystem and for not more than 150 days in any 12 month period.</li> <li>• Refer to ORO Letter</li> </ul>
<p>Administrative Support</p> <p>Includes the following:</p> <ul style="list-style-type: none"> <li>• Regional Hub Business Manager</li> <li>• Administrative Assistants</li> </ul>	<ul style="list-style-type: none"> <li>• Support the administrative functions of the Regional Hub/cluster/facility including coordinating delivery of training as required</li> <li>• Assist with entering operational training records into the appropriate database as directed</li> </ul>
<p>Municipal Operators working in the Cobalt Drinking Water System</p>	<ul style="list-style-type: none"> <li>• Fulfill duties assigned by their Supervisor</li> <li>• Regularly inspect the distribution system, perform routine maintenance and repairs and complete appropriate forms</li> </ul>



Ontario Clean Water Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water Systems

QEMS Proc.: OP-09  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 8 of 8

### ORGANIZATIONAL STRUCTURE, ROLES, RESPONSIBILITIES AND AUTHORITIES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

Role/Position	Responsibilities and Authorities
	<ul style="list-style-type: none"> <li>• Contact OCWA for all non-routine operational concerns or adjustments</li> <li>• Take control of emergency situations (eg. water main breaks) and complete repair according to applicable regulations, licences, permits and established operating procedures</li> <li>• Maintain the distribution log book according to regulatory requirements</li> <li>• Participate in facility inspections and audits</li> <li>• May act as Operator-in-Charge (OIC) if holds a Class I or higher certification for a water distribution subsystem</li> </ul>

#### 4. Related Documents

- OP-03 Commitment and Endorsement
- OP-04 QEMS Representative
- OP-05 Document and Records Control
- OP-09A Organizational Structure
- OP-12 Communications
- OP-20 Management Review

#### 5. Revision History

Date	Revision #	Reason for Revision
Mar. 17, 2022	0	Procedure issued
Oct. 11, 2023	1	Added responsibilities and authorities for Operations Supervisor, Senior Operator and Municipal operators. Removed positions of Team Lead - Capital and Team Lead - Operations and Maintenance as these positions have been replaced by Operations Supervisor. Removed position of Overall Responsible Operator (ORO) as this position can be the responsibility of any position listed in the table. Updated responsibilities for UPITs.
Jul, 8, 2024	2	Procedure updated with revisions to Table 9-2 as follows: Role/Position updated to clarify roles are performed by multiple positions, position titles updated, note added regarding OITs operating limitations. Clarified certification requirements when selected personal can act has OIC, ORO or alternate ORO. Remove position of Mechanic Operator and added position for Electronics Technician/Operator. Removed watermark.



Ontario Clean Water Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Doc.: OP-09A  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 1 of 2

### ORGANIZATIONAL STRUCTURE

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

## OPERATING AUTHORITY

### Ontario Clean Water Agency

#### Corporate Oversight

Board of Directors

\*President & Chief Executive Officer

\*Vice President of Operations

\*Vice President of Operations

Director of Operational Support Services

QEMS Coordinators  
Compliance Systems  
Coordinators

Corporate Compliance

\*Regional Hub Manager  
Northeastern Ontario  
**Top Management**

Administrative Support

Operations Management  
Temiskaming Shores  
**Top Management**

Safety, Process & Compliance Manager  
**Top Management**  
Alternate QEMS Representative

Operations Management  
Capital Projects  
**Top Management**

Process & Compliance Technician/  
QEMS Representative

#### OPERATIONS PERSONNEL

- Operations Supervisor
- Senior Water & Wastewater Operator
- Water & Wastewater Operator
- Instrumentation Technician (UPIT/SCADA Support/Operator)
- Electronics Technician/Operator

Day-to-Day Operations of the Cobalt Drinking Water System

*\*NOTE: Members of OCWA's Senior Leadership Team (SLT) include:*

- President and CEO & Executive Vice President and General Counsel
- Vice Presidents of OCWA's business units (includes VPs of Operations)
- Regional Hub Managers

**OWNER**  
The Town of Cobalt



Ontario Clean Water Agency

# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Doc.: OP-09A  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 2 of 2

### ORGANIZATIONAL STRUCTURE

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

### Revision History

Date	Revision #	Reason for Revision
Mar. 17, 2022	0	Appendix issued.
Oct. 11, 2023	1	Updated chart to include Operations Supervisor and Senior Operator; removed Mechanic Operator. Changed Vice President of Engineering, Capital & Support Services to Vice President of Operations
Jul, 8, 2024	2	Revised to include Senior Leadership Team (SLT) in reporting structure and identify members, added Compliance System Coordinators, updated Operations Personnel position titles, removed watermark.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-10  
 Rev Date: 2024-07-08  
 Rev No: 2  
 Pages: 1 of 6

### COMPETENCIES

Reviewed by: I Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

## 1. Purpose

To document a procedure that describes:

- the competencies required for personnel performing duties directly affecting drinking water quality;
- the activities to develop and/or maintain those competencies; and
- the activities to ensure personnel are aware of the relevance of their duties and how they affect safe drinking water.

## 2. Definitions

*Competence* – the combination of observable and measurable knowledge, skills, and abilities which are required for a person to carry out assigned responsibilities

*Operations Management* – refers to the Senior Operations Manager and/or Operations Manager that directly oversees a facility’s operations

*Operations Personnel* – employees of the drinking water system who perform various activities related to the compliance, operations and maintenance of the drinking water system that may directly affect drinking water quality

*Top Management* – a person, persons or a group of people at the highest management level within an operating authority that makes decisions respecting the QMS and recommendations to the Owner respecting the subject system or subject systems

## 3. Procedure

3.1 The following table presents the minimum competencies required by operations personnel.

Role/Position	Required Minimum Competencies
Operations Management (Top Management)	<ul style="list-style-type: none"> <li>• Valid operator certification required to fulfil certified operator duties (if assigned).</li> <li>• Experience and/or training in managing/supervising drinking water system operations, maintenance, financial planning and administration</li> <li>• Training and/or experience related to drinking water system processes, principles and technologies</li> <li>• Training on OCWA's QEMS and the DWQMS</li> <li>• Training on relevant legislation, regulations, codes, policies, guidelines and procedures</li> <li>• Experience using computers and operational computerized systems</li> </ul>



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-10  
 Rev Date: 2024-07-08  
 Rev No: 2  
 Pages: 2 of 6

### COMPETENCIES

Reviewed by: I Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

Role/Position	Required Minimum Competencies
<p>Safety, Process &amp; Compliance (SPC) Manager (Top Management)</p> <p>(May also fulfill the role of Alternate QEMS Representative)</p>	<ul style="list-style-type: none"> <li>• Valid operator certification; if required to act as Overall Responsible Operator (ORO), certification must be at the level of the facility or higher</li> <li>• Experience in providing technical support and leading/managing programs related to process control and compliant operations</li> <li>• Experience and/or training in conducting compliance audits, and management system audits</li> <li>• Experience and/or training in preparing and presenting informational and training material</li> <li>• Training on OCWA's QEMS and the DWQMS</li> <li>• Training on relevant legislation, regulations, codes, policies, guidelines and procedures</li> <li>• Experience using computers and operational computerized systems</li> </ul>
<p>Process &amp; Compliance Technician - PCT (QEMS Representative)</p>	<ul style="list-style-type: none"> <li>• Valid operator certification required to fulfil certified operator duties (if assigned)</li> <li>• Experience and/or training in resolving/addressing compliance issues for drinking water systems</li> <li>• Experience and/or training in monitoring, assessing and reporting on facility performance against legal requirements and corporate goals</li> <li>• Experience and/or training in preparing and presenting informational and training material</li> <li>• Experience in conducting management system audits or internal auditor education/training</li> <li>• Training on OCWA's QEMS and the DWQMS</li> <li>• Training on relevant legislation, regulations, codes, policies, guidelines and procedures</li> <li>• Experience using computers and operational computerized systems</li> </ul>
<p>Operations Supervisor Water &amp; Wastewater</p>	<ul style="list-style-type: none"> <li>• Valid operator certification; if required to act as Overall Responsible Operator (ORO), certification must be at the level of the facility or higher</li> <li>• Experience and/or training in managing and planning multiple projects, assessing priorities and effectively coordinating operation and maintenance programs</li> <li>• Experience leading/directing operations personnel, and providing technical guidance to resolve operational issues</li> <li>• Training and/or experience related to operations and maintenance of drinking water system processes, principles and technologies</li> <li>• Experience and/or training in financial planning and administration</li> <li>• Training on OCWA's QEMS and the DWQMS</li> </ul>





# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-10  
 Rev Date: 2024-07-08  
 Rev No: 2  
 Pages: 3 of 6

### COMPETENCIES

Reviewed by: I Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

Role/Position	Required Minimum Competencies
	<ul style="list-style-type: none"> <li>• Training on relevant legislation, regulations, codes, policies, guidelines and procedures</li> <li>• Experience using computers and operational computerized systems</li> </ul>
<p>Certified Operator</p> <p>Includes the following:</p> <ul style="list-style-type: none"> <li>• Senior Water &amp; Wastewater Operator</li> <li>• Water &amp; Wastewater Operator</li> <li>• Water &amp; Wastewater Operator-in-Training</li> </ul>	<ul style="list-style-type: none"> <li>• Valid operator certification</li> <li>• If required to act as ORO, certification must be at the level of the facility or higher</li> <li>• If required to act as Operator-in-Charge (OIC), certification must be level 1 or higher</li> <li>• Training and/or experience in inspecting and monitoring drinking water system processes and performing/planning maintenance activities,</li> <li>• Performs maintenance activities, including preventative, emergency and capital works</li> <li>• Training on OCWA's QEMS and the DWQMS</li> <li>• Training on relevant legislation, regulations, codes, policies, guidelines and procedures</li> <li>• Experience using computers and operational computerized systems</li> </ul>
<p>Instrumentation Technician (UPIT)/SCADA Support/Operator or Electronics Technician/Operator</p>	<ul style="list-style-type: none"> <li>• Valid operator certification required to fulfil certified operator duties (if assigned)</li> <li>• If required to act as ORO, certification must be at the level of the facility or higher</li> <li>• If required to act as Operator-in-Charge (OIC), certification must be level 1 or higher</li> <li>• Electrical Engineering diploma and/or Instrumentation Technology diploma</li> <li>• Experience and/or training in monitoring, programming, installing and troubleshooting network, hardware, software and instrumentation</li> <li>• Experience in performing maintenance and repair of electrical and electronic equipment</li> <li>• Experience and/or training in drinking water system processes design, instrumentation, process control and automation systems</li> <li>• Training on OCWA's QEMS and the DWQMS</li> <li>• Training on relevant legislation, regulations, codes, policies, guidelines and procedures</li> <li>• Experience using computers and operational computerized systems</li> </ul>
<p>Administrative Support</p> <p>Includes the following:          Regional Business Hub Manager,</p>	<ul style="list-style-type: none"> <li>• Experience and/or training related to procurement and business administration practices</li> <li>• Knowledge of OCWA's QEMS and the DWQMS</li> <li>• Knowledge of relevant legislation, regulations, codes, policies, guidelines and procedures</li> </ul>



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-10  
 Rev Date: 2024-07-08  
 Rev No: 2  
 Pages: 4 of 6

### COMPETENCIES

Reviewed by: I Bruneau, QEMS Representative | Approved by: B. Logan, Operations Manager

Role/Position	Required Minimum Competencies
Administrative Assistants	<ul style="list-style-type: none"> <li>• Experience using computers</li> </ul>
Municipal Operators working in the Cobalt Drinking Water System	<ul style="list-style-type: none"> <li>• Valid operator certification (appropriate certification required if acting as OIC, ORO or alternate ORO.)</li> <li>• Experience and/or training of the distribution system operations</li> <li>• Training in water treatment processes</li> <li>• Experience and training on the maintenance and repair of a variety of equipment and structures</li> <li>• Training on relevant legislation, regulations, codes, policies, guidelines and procedures</li> <li>• Knowledge of OCWA's QEMS and the DWQMS</li> </ul>

3.2 OCWA's recruiting and hiring practices follow those of the Ontario Public Service (OPS). As part of the OPS, minimum competencies, which include education, skills, knowledge and experience requirements, are established when designing the job description for a particular position. As part of the recruitment process, competencies are then evaluated against the job description. Based on this evaluation, the hiring manager selects and assigns personnel for specific duties.

3.3 OCWA's Operational Training Program aims to:

- Develop the skills and increase the knowledge of staff and management;
- Provide staff with information and access to resources that can assist them in performing their duties; and
- Assist OCWA certified operators in meeting the legislative and regulatory requirements with respect to training.

3.4 The Program consists of Director Approved, continuing education and on-the-job training and is delivered using a combination of methods (e.g., traditional classroom courses, e-learning/webinars and custom/program-based courses/sessions). A formal evaluation process is in place for all sessions under the Operational Training Program and is a critical part of the Program's continual improvement.

3.5 Awareness of OCWA's QEMS is promoted during the orientation of new staff, at facility/cluster/regional hub level training sessions and meetings and through OCWA's Environmental Compliance 101 (EC 101) course. All new staff are required to complete the EC 101 course within their first year of joining OCWA. The purpose of the EC 101 course is to ensure staff are aware of applicable legislative and regulatory requirements, to promote awareness of OCWA's QEMS and to reinforce their roles and responsibilities under OCWA's QEMS.

3.6 Staff are also required to complete the training listed in OCWA's Mandatory Training Requirements procedure, based on their position and/or the duties they perform. This list includes mandatory environmental and health and safety compliance training, as



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-10  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 5 of 6

### COMPETENCIES

Reviewed by: I Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

well as the training deemed mandatory by OCWA corporate and Ontario Public Service (OPS) policies and is available on OCWA's intranet (sharepoint site).

- 3.7 Operations personnel also receive site-specific training/instruction on relevant operational and emergency response procedures to ensure effective operational control of processes and equipment which may impact the safety and quality of drinking water.
- 3.8 As part of OCWA's annual Performance Planning and Review (PPR) process, employee performance is evaluated against their job expectations. Professional development opportunities and training needs (which could include formalized courses as well as site-specific on-the-job training or job shadowing/mentoring) are identified as part of this process (and on an ongoing basis). In addition to this process, OCWA employees may at any time request training from either internal or external providers by obtaining approval from their Manager.
- 3.9 Certified drinking water operators are responsible for completing the required number of training hours in order to renew their certificates based on the highest class of drinking water subsystem they operate. They are also responsible for completing mandatory courses required by *Safe Drinking Water Act (SDWA)* O. Reg. 128/04 Certification of Drinking Water System Operators and Water Quality Analysts. The Operations Management takes reasonable steps to ensure that every operator has the opportunity to attend training to meet the requirements.
- 3.10 It is the responsibility of operations personnel to ensure Operations Management are aware of any change to the status/classification of their drinking water operator certificate(s), the validity of their driver's licence (required to hold at a minimum a Class G license which is initially verified upon hire) and/or the validity of any other required certificates/qualifications.
- 3.11 Individual OCWA employee training records are maintained and tracked using a computerized system, the Training Summary database, which is administrated by OCWA's Learning and Development Department.

#### 4. Related Documents

OCWA's Learning and Development Resources (OCWA Intranet/sharepoint)  
OCWA's Mandatory Training Requirements (OCWA intranet/sharepoint)  
OCWA's Training Summary Database  
Performance Planning and Review (PPR) Database  
OP-5 Document and Records Control



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-10  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 6 of 6

**COMPETENCIES**

Reviewed by: I Bruneau, QEMS Representative

Approved by: B. Logan, Operations Manager

**5. Revision History**

<b>Date</b>	<b>Revision #</b>	<b>Reason for Revision</b>
Sep. 14, 2022	0	Procedure issued
Oct. 11, 2023	1	Added competencies for Operations Supervisor, Senior Operator and municipal operators. Removed position of Team Lead has been replaced by Operations Supervisor. Removed Overall Responsible Operator (ORO) as this position can be the responsibility of any position listed in the table. Updated competencies for UPITs.
Jul. 8, 2024	2	Procedure updated with revisions to table in 3.1 Role/Position updated to clarify roles are performed by multiple positions, included statements regarding certification requirements and updated position titles. Updated Procedure to reflect changes to title and content of OCWA's Mandatory Training Requirements Document and added sharepoint. Removed watermark.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-11  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 1 of 3

### PERSONNEL COVERAGE

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

## 1. Purpose

To describe the procedure for ensuring that sufficient and competent personnel are available for duties that directly affect drinking water quality at the Cobalt Drinking Water System.

## 2. Definitions

*Competency* – an integrated set of requisite skills and knowledge that enables an individual to effectively perform the activities of a given occupation \*

*Essential Services* – services that are necessary to enable the employer to prevent,

- (a) danger to life, health or safety,
- (b) the destruction or serious deterioration of machinery, equipment or premises,
- (c) serious environmental damage, or
- (d) disruption of the administration of the courts or of legislative drafting.

(*Crown Employees Collective Bargaining Act, 1993*)

## 3. Procedure

- 3.1 Operations Management ensures that personnel meeting the competencies identified in OP-10 Competencies are available for duties that directly affect drinking water quality.
- 3.2 The Cobalt Drinking Water System is considered un-manned facility. OCWA certified operations personnel routinely visit the system at least twice per week between the hours of 0730 and 1600 hours. The facility is monitored daily using OCWA's remote monitoring SCADA system. OCWA operators are available 24 hours a day, 7 days a week by an alarm system and cell phone.
- 3.3 The Town of Cobalt Public Works staff conduct regular checks of the distribution system and inform OCWA operations of any problems.
- 3.4 Operations personnel are assigned to act as and fulfill the duties of Overall Responsible Operator (ORO) and Operator-in-Charge (OIC) in accordance with SDWA O. Reg. 128/04.

Refer to the ORO Letter for current and alternate OROs and to the procedure for the Designation of OICs in the Temiskaming Shores Cluster for a list of OICs. The designated OIC for each shift is recorded in the facility logbook.

---

\* Based on the 2005 National Occupational Guidelines for Canadian Water and Wastewater Operators and International Board of Standards for Training, Performance and Instruction



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-11  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 2 of 3

**PERSONNEL COVERAGE**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

- 3.5 The Senior Operations Manager and/or designate assigns an on-call operator for the time that the facility is un-staffed (i.e.: evenings, weekends and Statutory Holidays). The on-call shift rotates every Monday morning at 0730 hours, unless Monday is a statutory holiday in which case the change is on Tuesday morning at 0730 hours. The on-call schedule is maintained by the Operations Manager and is available to operators in the Microsoft Outlook shared calendar.

The on-call operator is responsible for responding to the alarm monitoring service within a reasonable time frame. Details of the call-ins are maintained electronically in OCWA Workplace Management System (WMS).

- 3.6 The alarm system auto dialer is programmed to contact the operator on-call. The operator on-call is responsible for responding to the alarm within a reasonable timeframe. If the nature of the alarm requires additional staff, the on-call operator can request assistance from any of the other certified operators. The on-call operator ensures details of the call-in are documented in the facility logbook. OCWA operators also record details in OCWA's Workplace Management System (WMS/Maximo).
- 3.7 The Senior Operations Manager and/or designate is responsible for approving vacation time for staff in a manner which ensures sufficient personnel are available for the performance of normal operating duties.
- 3.8 OCWA's Operations staff are represented by the Ontario Public Service Employees Union (OPSEU). In the event of a labour disruption, the Operations Manager, together with the union, identifies "essential services" required to operate the facility so that the quality of drinking water is not compromised in any way.
- 3.9 A contingency plan for Critical Shortage of Staff is included in the Facility Emergency Plan. This plan provides direction to staff in the event that there is a severe shortage of staff due to sickness (e.g., pandemic flu) or other unusual situations where personnel might not be available.

**1. Related Documents**

Call-In Reports (WMS)  
Critical Shortage of Staff Contingency Plan (Facility Emergency Plan)  
Facility Logbook  
Facility Round Sheets  
On-Call Schedule  
ORO Letter  
Vacation Schedule  
OP-10 Competencies



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-11  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 3 of 3

**PERSONNEL COVERAGE**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

**2. Revision History**

<b>Date</b>	<b>Revision #</b>	<b>Reason for Revision</b>
Mar. 17, 2022	0	Procedure issued.
Oct. 11, 2023	1	Revised Step 3.2 to include a timeframe for routine visits and added regulator checks of the distribution system by Town Staff. Changed the location of the on-call schedule from a paper calendar to an on-line calendar in Step 3.4 and updated how call-outs are documented in step 3.5.
Jul. 8, 2024	2	Revised Step 3.3 to reference the procedure for the Designation of OICs. Updated Operations Supervisor to Operations Manager. Removed watermark.



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-12  
Rev Date: 2024-07-08  
Rev No: 1  
Pages: 1 of 4

## COMMUNICATIONS

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

### 1. Purpose

To describe the procedure for facility level internal and external QEMS-related communications between Top Management and:

- OCWA staff;
- the Owner;
- essential suppliers and service providers (as identified in OP-13); and
- the public.

### 2. Definitions

*Operations Management* – refers to the Senior Operations Manager and/or Operations Manager that directly oversees a facility's operations

*Operations Personnel* – employees of the drinking water system who perform various activities related to the compliance, operations and maintenance of the drinking water system that may directly affect drinking water quality.

### 3. Procedure

3.1 Operations Management and the QEMS Representative are responsible for identifying and coordinating any site-specific communications in relation to the status/development of the facility's QEMS.

3.2 Internal and external communication responsibilities and reporting requirements for emergency situations are set out under OCWA's Emergency Management Program (i.e., Facility Emergency Plan and OCWA's Corporate Response Plan). Refer to OP-18 Emergency Management for more information.

3.3 Communication with OCWA staff:

3.3.1 Within the first year of hire, all staff are required to complete the Environmental Compliance 101 (EC101) course. The objective of the EC 101 course is to ensure that staff are aware of applicable legislative and regulatory requirements and of OCWA's QEMS and to reinforce their roles and responsibilities under OCWA's QEMS.

3.3.2 Operations Management are responsible for ensuring operations personnel receive site-specific training on the Operational Plan, the organizational structure for the facility including the roles and responsibilities and authorities (outlined in OP-09 Organizational Structure, Roles, Responsibilities and Authorities), QEMS Procedures and other related operating instructions and procedures as part of the orientation process and on an on-going basis as required.





**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-12  
Rev Date: 2024-07-08  
Rev No: 1  
Pages: 2 of 4

**COMMUNICATIONS**

Reviewed by: I. Bruneau, QEMS Representative | Approved by: B. Logan, Sr. Operations Manager

3.3.3 The Safety, Process and Compliance (SPC) Manager is responsible for ensuring training is provided for the Regional Hub (in consultation with Operations Management as required) on applicable legislative and regulatory requirements and the QEMS.

3.3.4 The QEMS Representative assists Operations Management and/or the SPC Manager in the coordination/delivery of training as required.

3.3.5 Revisions to the QEMS and associated documentation are communicated as per OP-05 Document and Records Control.

3.3.6 The QEMS Policy is available to all OCWA personnel through OCWA's intranet and as outlined in 3.6.2 of this procedure.

3.3.7 Operations personnel are responsible for identifying potential hazards at the facility that could affect the environmental and/or public health, and communicating these to Operations Management. They may also recommend changes be made to improve the facility's QEMS by making a request to the QEMS Representative (as per OP-05).

3.3.8 The QEMS Representative is responsible for ensuring that the Operations Management and the SPC Manager are informed regarding the compliance/quality status of the facility and QEMS implementation and any need for improved processes/procedures at the cluster/facility level.

3.3.9 The SPC Manager reports to the Regional Hub Manager on the compliance status, the QEMS performance and effectiveness, any need for improvement and on issues that may have Agency-wide significance. Operations Management reports to the Regional Hub Manager on facility operational performance.

3.4 Communication with the Owner:

3.4.1 The Regional Hub Manager, Operations Management and SPC Manager ensures that the Owner is provided with QEMS updates and that they are kept informed of the status of the facility's operational and compliance performance through electronic and/or verbal communications. The QEMS Representative/PCT assists in the coordination of these meetings and with communicating the updates as directed.

3.4.2 The continuing suitability, adequacy and effectiveness of OCWA's QEMS are communicated to the Owner as part of the Management Review process (refer to OP-20 Management Review).



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-12  
Rev Date: 2024-07-08  
Rev No: 1  
Pages: 3 of 4

## COMMUNICATIONS

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

### 3.5 Communications with Essential Suppliers and Service Providers:

3.5.1 Communication requirements to ensure essential suppliers and service providers understand the relevant OCWA QEMS policies, procedures and expectations are described in OP-13 Essential Supplies and Services.

### 3.6 Communication with the Public:

3.6.1 Media enquiries must be directed to the facility’s designated media spokesperson as identified in the Facility Emergency Plan. The media spokesperson coordinates with local and corporate personnel (as appropriate) and the Owner in responding to media enquiries.

3.6.2 OCWA’s QEMS and QEMS Policy are communicated to the public through OCWA’s public website ([www.ocwa.com](http://www.ocwa.com)). The QEMS Policy is also posted at the Haileybury Water Treatment Plant.

3.6.3 Facility tours of interested parties must be approved in advance by the Owner. A record of any tour is made in the facility logbook.

3.6.4 All complaints, whether received from the consumer, the community or other interested parties, are documented on a Community Complaint form. As appropriate, the Operations Management or the ORO ensures that the Owner is informed of the complaint and/or an action is developed to address the issue in a timely manner. The QEMS Representative ensures that consumer feedback is included for discussion at the Management Review.

## 4. Related Documents

- Community Complaint Form
- Emergency Response Plan
- Facility Emergency Plan
- OP-05 Document and Records Control
- OP-09 Organizational Structure, Roles, Responsibilities and Authorities
- OP-13 Essential Supplies and Services
- OP-18 Emergency Management
- OP-20 Management Review

## 5. Revision History

Date	Revision #	Reason for Revision
Sep.14, 2022	0	Procedure issued
Jul. 8, 2024	1	Procedure revised to reference updated title of Corporate Emergency Response Plan, to add the link to OCWA’s public website and to correct



Ontario Clean Water Agency

# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-12  
Rev Date: 2024-07-08  
Rev No: 1  
Pages: 4 of 4

## COMMUNICATIONS

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

the location of the policy from the Matheson to the Hailebyury water treatment plant. Changed Team Lead to ORO. Removed watermark.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-13  
Rev Date: 2023-10-11  
Rev No: 1  
Pages: 1 of 3

### ESSENTIAL SUPPLIES AND SERVICES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: J. Galda, SPC Manager

#### 1. Purpose

To describe OCWA's procedures for procurement and for ensuring the quality of essential supplies and services.

#### 2. Definitions

*Essential Supplies and Services* – supplies and services deemed to be critical to the delivery of safe drinking water

#### 3. Procedure

3.1 Essential supplies and services for the Cobalt Drinking Water System are contained in the Facility Emergency Plan on the Essential Supplies and Services List. The list is reviewed at least once every calendar year by the QEMS Representative and updated as required.

3.2 Purchasing is conducted in accordance with OCWA's Corporate Procurement and Administration policies, procedures and guidelines, which are adopted from those of the Ontario Public Service.

Purchases of capital equipment are subject to formal approval by the facility's owner.

Sole sourced purchases are made through vendors that have been researched by OCWA's procurement department and are capable of delivering the required product or service when needed.

3.3 As part of the corporate procurement process, potential suppliers/service providers are informed of relevant aspects of OCWA's QEMS through the tendering process and through specific terms and conditions set out in our agreements and purchase orders. Essential suppliers and service providers (including those contracted locally) are sent a letter that provides an overview of the relevant aspects of the QEMS.

3.4 Contractors are selected based on their qualifications and ability to meet the facility's needs without compromising operational performance and compliance with applicable legislation and regulations.

Contracted personnel including suppliers may be requested or required to participate in additional relevant training/orientation activities to ensure conformance with facility procedures and to become familiar with OCWA workplaces.

If necessary, appropriate control measures are implemented while contracted work is being carried out and communicated to all relevant parties to minimize the risk to the integrity of the drinking water system and the environment.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-13  
Rev Date: 2023-10-11  
Rev No: 1  
Pages: 2 of 3

### ESSENTIAL SUPPLIES AND SERVICES

Reviewed by: I. Bruneau, QEMS Representative

Approved by: J. Galda, SPC Manager

- 3.5 All third-party drinking water testing services are provided by accredited and licensed laboratories. The Ministry has an agreement with The Canadian Association for Laboratory Accreditation (CALA) for accreditation of laboratories testing drinking water. The QEMS Representative is responsible for notifying the Ministry of any change to the drinking water testing services being utilized.
- 3.6 Internal verification and calibration activities (e.g. chlorine analyzer, turbidimeter, flowmeters, etc.) are conducted by operations personnel in accordance with equipment manuals and/or procedures (Refer to OP-17 Measurement Recording Equipment Calibration and Maintenance).
- 3.7 External calibration activities, if required are conducted by qualified third-party providers. Qualifications of the service provider are verified during the procurement process. The service provider is responsible for providing a record/certificate of all calibrations conducted.
- 3.8 Chemicals purchased for use in the drinking water treatment process must meet AWWA Standards and be ANSI/NSF certified as per the Municipal Drinking Water Licence (MDWL).
- 3.9 The facility orders and receives ongoing deliveries of chemicals to satisfy current short-term needs based on processing volumes and storage capacities. Incoming chemical orders are verified by reviewing the manifest or invoice in order to confirm that the product received is the product ordered.
- 3.10 Process components/equipment provided by the supplier must meet applicable regulatory requirements and industry standards for use in drinking water systems prior to their installation.
- 3.11 To ensure the safe delivery of drinking water, the Town maintains an inventory of critical repair components. The Town orders these distribution components through reliable suppliers that provide parts with applicable certification and standards. Components are verified by the Public Works Department to ensure the correct product was received.

#### 4. Related Documents

ANSI/NSF Documentation  
AWWA Standards  
Calibration Certificates/Records  
Essential Supplies and Services List  
Municipal Drinking Water Licence (MDWL)  
OP-17 Measurement Recording Equipment Calibration and Maintenance



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-13  
Rev Date: 2023-10-11  
Rev No: 1  
Pages: 3 of 3

**ESSENTIAL SUPPLIES AND SERVICES**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: J. Galda, SPC Manager

**5. Revision History**

<b>Date</b>	<b>Revision #</b>	<b>Reason for Revision</b>
Mar. 17, 2022	0	Procedure issued
Oct. 11, 2023	1	Step 3.2 was revised to include a statement regarding sole sourced purchases. Added step 3.11 to describe the Town's purchasing and receiving process for distribution components



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-14  
Rev Date: 2024-07-08  
Rev No: 1  
Pages: 1 of 2

### REVIEW AND PROVISION OF INFRASTRUCTURE

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

## 1. Purpose

To describe OCWA's procedure for reviewing the adequacy of infrastructure necessary to operate and maintain the Cobalt Drinking Water System.

## 2. Definitions

*Infrastructure* – the set of interconnected structural elements that provide the framework for supporting the operation of the drinking water system, including buildings, workspace, process equipment, hardware, software and supporting services, such as transport or communication

## 3. Procedure

3.1 At least once every calendar year, Operations Management in conjunction with operations personnel conducts a review of the drinking water system's infrastructure to assess its adequacy for the operation and maintenance of the system. Operations personnel assist with identifying the need for infrastructure repairs, replacements or alterations and with prioritizing each identified item. Documents and records that are reviewed may include:

- Maintenance records
- Call-in reports
- Adverse Water Quality Incidents (AWQIs) or other incidents
- Health & Safety Inspections
- Ministry Inspection Reports
- QEMS Audit Reports

3.2 The outcomes of the risk assessment documented as per OP-08 are considered as part of this review.

3.3 The output of the review is a minimum 5 year rolling Recommended Capital and Major Maintenance Report to assist the Owner and OCWA with planning infrastructure needs for the short and long-term. Each year a letter and/or list summarizing capital works recommendations and estimated expenditures for the upcoming year is submitted to the Owner for review and approval.

3.4 The final approved capital items form the long term forecast for any major infrastructure maintenance, rehabilitation and renewal activities as per OP-15.

3.5 Operations Management ensures that results of this review are considered during the Management Review process (OP-20).



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-14  
Rev Date: 2024-07-08  
Rev No: 1  
Pages: 2 of 2

**REVIEW AND PROVISION OF INFRASTRUCTURE**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

**4. Related Documents**

Capital and Major Maintenance Recommendations Report  
Capital Letter & Acknowledgement/Approval from the Owner  
Management Review Minutes  
OP-08 Risk Assessment Outcomes  
OP-15 Infrastructure Maintenance, Rehabilitation and Renewal  
OP-20 Management Review

**5. Revision History**

<b>Date</b>	<b>Revision #</b>	<b>Reason for Revision</b>
Sep. 14, 2022	0	Procedure issued
Jul. 8, 2024	1	Added the word "minimum" prior the statement; 5 year rolling Recommended Capital and Major Maintenance Report in Step 3.1 as additional years can be forecasted. Changed MECP to Ministry. Removed watermark.





# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-15  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 1 of 3

### INFRASTRUCTURE MAINTENANCE, REHABILITATION AND RENEWAL

Reviewed by: I Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

## 1. Purpose

To describe OCWA's infrastructure maintenance, rehabilitation and renewal program for the Cobalt Drinking Water System.

## 2. Definitions

*Infrastructure* – the set of interconnected structural elements that provide the framework for supporting the operation of the drinking water system, including buildings, workspace, process equipment, hardware, software and supporting services, such as transport or communication

*Rehabilitation* – the process of repairing or refurbishing an infrastructure element.

*Renewal* – the process of replacing the infrastructure elements with new elements.

## 3. Procedure

3.1 OCWA, under contract with the Owner, maintains a computerized Work Management System (WMS) to manage maintenance, rehabilitation and renewal of infrastructure for which it is operationally responsible. The major components of the WMS consist of planned maintenance, unplanned maintenance, rehabilitation, renewal and program monitoring and reporting.

### 3.1.1 Planned Maintenance

Routine planned maintenance activities include:

- Inspect, adjust and calibrate process control equipment to ensure proper operation of water systems, pumps, chemical feeders, and all other equipment installed at the facilities.
- Inspect standpipe and tower.
- Perform routine maintenance duties to equipment including checking machinery and electrical equipment when required.
- Maintain an inventory of all equipment
- Maintain accurate records of work conducted, activities, and achievements.

Planned maintenance activities are scheduled in the WMS that allows the user to:

- Enter detailed asset information;
- Generate and process work orders;
- Access maintenance and inspection procedures;
- Plan preventive maintenance and inspection work;
- Plan, schedule and document all asset related tasks and activities; and
- Access maintenance records and asset histories.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-15  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 2 of 3

### INFRASTRUCTURE MAINTENANCE, REHABILITATION AND RENEWAL

Reviewed by: I Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

Planned maintenance activities are communicated to the person responsible for completing the task through the issuance of WMS work orders. Work orders are automatically generated on a daily, weekly, monthly, quarterly and annual schedule as determined based on manufacturer's recommendations and site specific operational and maintenance needs and are assigned directly to the appropriate operations personnel. This schedule is set up by the Team Lead/Senior Operator. Work orders are completed and electronically entered into WMS by the person responsible for completing the task. Records of these activities are maintained as per OP-05 Document and Records Control.

The Operations Manager or designate, maintains the inventory of equipment in WMS and ensures that appropriate maintenance plans are in place. Maintenance plans are developed according to the manufacturer's instructions, regulatory requirements, industry standards, and/or client service requirements. Equipment Operation and Maintenance (O&M) manuals are accessible to operations personnel at the locations specified in OP-05 Document and Records Control.

#### 3.1.2 Unplanned Maintenance

Unplanned maintenance is conducted as required. All unplanned maintenance activities are authorized by the Operations Management. Unplanned maintenance activities are recorded in the facility's logbook and as corrective/emergency work order and are entered into WMS by the person responsible for completing the unplanned maintenance activity.

#### 3.1.3 Rehabilitation and Renewal

Rehabilitation and renewal activities including capital upgrades (major infrastructure maintenance) are determined at least once every calendar year in consultation with Operations Management and the Owner. A list of required replacement equipment or desired new equipment is compiled and prioritized by Operations Management in conjunction with operations personnel and is presented to the Owner for review and comment. All major expenditures require the approval of the Owner. In addition to the short-term facility needs (i.e. current year), the Capital and Major Maintenance Recommendations Report also provides a long-term (i.e. rolling 5-year) list of major maintenance recommendations. (Refer to OP-14 Review and Provision of Infrastructure).

#### 3.1.4 Program Monitoring and Reporting

Maintenance needs for the facility are determined through review of manufacturer's instructions, regulatory requirements, industry standards, and/or client service requirements and are communicated by means of work orders. Additionally, Operations Management and operations personnel conduct a review of the drinking water system's infrastructure to assess its adequacy for the



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-15  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 3 of 3

## INFRASTRUCTURE MAINTENANCE, REHABILITATION AND RENEWAL

Reviewed by: I Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

operation and maintenance of the system. (Refer to OP-14 Review and Provision of Infrastructure).

To assist in monitoring the effectiveness of the program, Operations Management (or designate) can review the WMS dashboard for a quick visualization of work order status and they generate summary reports as needed.

3.2 OCWA's infrastructure maintenance, rehabilitation and renewal program is initially communicated to the Owner through the operating agreement. OCWA's program is communicated to the Owner at a minimum once every calendar year through submission of the capital list/letter and the results of the Management Review.

#### 4. Related Documents

Capital and Major Maintenance Recommendations Report  
Capital Letter & Acknowledgement/Approval from the Owner  
Minutes of Management Review  
OP-05 Document and Records Control  
OP-14 Review and Provision of Infrastructure

#### 5. Revision History

Date	Revision #	Reason for Revision
Sep. 14, 2022	0	Procedure issued
Oct. 11, 2023	1	Added the inspection of the standpipe to Step 3.1.1. Changed Team Lead to Operations Supervisor and added Instrumentation Technician in Step 3.1.1 and updated step 3.1.4 to include the WMS dashboard as a means of monitoring the effectiveness of the program.
Jul. 8, 2024	2	Revised Step 3.1.1 to remove Operations Supervisor and Instrumentation Technician and to add the Operations Manager and as personnel responsible for maintaining the WMS. Removed watermark.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-16  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 1 of 4

### SAMPLING, TESTING AND MONITORING

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

## 1. Purpose

To describe the procedure for sampling, testing and monitoring for process control and finished drinking water quality.

## 2. Definitions

*Challenging Conditions* – any existing characteristic of the water source or event-driven fluctuations that impact the operational process as identified and listed under OP-06A and OP-06B Drinking Water System

## 3. Procedure

- 3.1 All sampling, monitoring and testing is conducted at a minimum in accordance with SDWA O. Reg. 170/03 and the facility's Municipal Drinking Water License (MDWL).
- 3.2 Sampling requirements for the facility are defined in the facility's sampling schedule which is available to operations personnel, at the location(s) noted in OP-05 Document and Records Control. The sampling schedule is maintained by the PCT and is updated as required.
- 3.3 Samples that are required to be tested by an accredited and licensed laboratory, are collected, handled and submitted according to the directions provided by the licensed laboratory(ies) that conducts the analysis. The laboratory(ies) used for this facility are listed in the Essential Supplies and Services List (within the Facility Emergency Plan (FEP)).

Electronic and/or hardcopy reports received from the laboratory are maintained as per OP-05 Document and Records Control. Analytical results from laboratory reports are uploaded into OCWA's Process Data Management system (PDM).

- 3.4 Continuous monitoring equipment is used to sample and test for the following parameters related to process control and finished drinking water quality for the Cobalt DWS.
  - Turbidity – raw water, filters 1-4, treated water
  - Free chlorine residual – into the standpipe, treated water out of the standpipe
  - UV dosage and intensity – treated water
  - pH – raw water and treated water
  - Temperature – raw water and treated water
  - Level – wastewater, standpipe, elevated water tower
  - Flow rates – raw water, treated water, backwash waste flow, filter flow (calculated using raw and back wash flows).
  - Pressure (into the distribution system)



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-16  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 2 of 4

### SAMPLING, TESTING AND MONITORING

Reviewed by: I. Bruneau, QEMS Representative | Approved by: B. Logan, Sr. Operations Manager

Continuous monitoring equipment is also used to capture the following parameters for the Coleman Distribution System.

- Free chlorine residual (only when the standpipe is out of service)
- Flows

Test results from continuous monitoring equipment are captured by OCWA's SCADA system and are reviewed by a certified operator in accordance with the requirements of SDWA O. Reg. 170/03.

- 3.5 Adverse water quality results/incidents are responded to and reported as per Environmental Emergency Procedures (EEPs) found in the Facility Emergency Plan Binder.
- 3.6 In-house process control activities are conducted on a regular basis by the certified operator(s) on duty and at a minimum are conducted as follows:

Operational Parameter	Location	Frequency
Alkalinity	Raw water Process water	Grab weekly
Colour	Raw and treated water	Grab weekly
Temperature	Raw and treated water	Grab weekly
Aluminum Residual	Treated water	Grab weekly
Turbidity	Process water	Grab weekly
pH	Process water	Grab weekly
Free Chlorine Residual	Treated water Distribution water (various locations)	Grab weekly Grab 7x/week (4&3)
Stern PAC Usage	WTP	Bi-weekly reading
Chlorine Gas Usage	WTP - Chlorine room	Bi-weekly reading
Sodium Hydroxide Usage	WTP	Bi-weekly reading
Turbidity	Process water	Grab monthly

In-house samples are analyzed following approved laboratory procedures. The sampling results are recorded on a facility round sheet and are entered into the PDM system. Any required operational process adjustments are recorded in the facility log book.

- 3.7 Additional sampling, testing and monitoring activities related to the facility's most challenging conditions are captured in the existing in-house program as described above.

Monitoring/sampling for harmful algal blooms (HABs) is conducted during the HAB season (the warm seasonal period at a minimum starting on June 1<sup>st</sup> and continuing until October 31<sup>st</sup> each year) based on the drinking water systems HAB Monitoring, Reporting and Sampling Plan.



# OPERATIONAL PLAN

## Cobalt Drinking Water System

QEMS Proc.: OP-16  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 3 of 4

### SAMPLING, TESTING AND MONITORING

Reviewed by: I. Bruneau, QEMS Representative | Approved by: B. Logan, Sr. Operations Manager

- 3.8 There are no relevant upstream sampling, testing and monitoring activities that take place for Cobalt drinking water system.
- 3.9 Sampling, testing and monitoring results are readily accessible to the Owner at the Town Office, Kirkland Lake Process and Compliance office and/or Haileybury Water Treatment Plant.

The Owner is provided a Quarterly Operations Reports which discusses regulatory results and operational issues. Owners are also provided with an annual summary of sampling, testing and monitoring results through the SDWA O. Reg. 170/03 Section 11 - Annual Report, Schedule 22 - Municipal Summary Report and through the Management Review process outlined in OP-20 Management Review.

In addition, updates regarding sampling, testing and monitoring activities are provided as per the operating agreement and during regular client meetings.

#### 4. Related Documents

- Annual Report (O. Reg. 170 Section 11)
- Continuous Monitoring of Operational Parameters for Drinking Water Systems SOP
- Data Review Protocol
- Emergency Contact List/Essential Supplies & Services List (Contacts section of FEP)
- Facility Emergency Plan (FEP) Binder
- Facility Logbook
- Facility Round Sheets
- HAB Monitoring, Reporting and Sampling Plan
- Laboratory Analysis Reports
- Laboratory Chain of Custody Forms
- Municipal Summary Report (O. Reg. 170 Schedule 22)
- Process Data Management System (PDM)
- Quarterly Operations Reports
- Reporting Adverse Water Quality (EEP)
- Sampling Schedules
- SCADA Records
- WMS Records
- OP-05 Document and Records Control
- OP-06 Drinking Water System

#### 5. Revision History

Date	Revision #	Reason for Revision
Mar. 17, 2022	0	Procedure issued
Oct. 25, 2022	1	Section 3.6 added "Continuous" to the table for frequency of temperature monitoring
Oct. 11, 2023	2	Revised Step 3.4 to include UV intensity, raw and treated water temperature, standpipe and elevated tower levels, filter flow,



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-16  
Rev Date: 2024-07-08  
Rev No: 3  
Pages: 4 of 4

**SAMPLING, TESTING AND MONITORING**

Reviewed by: I. Bruneau, QEMS Representative | Approved by: B. Logan, Sr. Operations Manager

Date	Revision #	Reason for Revision
		pressure, wastewater levels, backwash waste flow and Coleman distribution system parameters. Updated table in Step 3.6 to include process water pH and temperature, raw water colour and temperature and changed polymer to Stern PAC. Clarified the frequency for distribution chlorine residual sampling. Updated location of results in Step 3.9.
Jul. 8, 2024	3	Clarified that filter flow is calculated from raw and backwash flows in Step 3.4. Modified section 3.6 to clarify that the frequency of in-house process control activities is at a 'minimum' frequency which will allow for flexibility if additional sampling conducted beyond that referenced in table/sampling schedule. Added reference to HAB Plan under Step 3.7 and updated Section. 4 – Reference. Removed watermark.



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-17  
Rev Date: 2024-07-08  
Rev No: 1  
Pages: 1 of 2

**MEASUREMENT AND RECORDING EQUIPMENT  
CALIBRATION AND MAINTENANCE**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

**1. Purpose**

To describe the procedure for the calibration and/or verification and maintenance of measurement and recording equipment at the Cobalt Drinking Water System.

**2. Definitions**

None

**3. Procedure**

- 3.1 All measurement and recording equipment calibration and maintenance activities must be performed by appropriately trained and qualified personnel or by a qualified third-party calibration service provider (refer to OP-13 Essential Supplies and Services).
- 3.2 The Instrumentation Technician establishes and maintains a list of measurement and recording devices and associated calibration and/or verification schedules using the automated Work Management System (WMS). When a new device is installed, it is added to the WMS system by a SuperUser (Operations Manager or designate). The new device is tagged with a unique identification number and the maintenance schedule is set up. Work orders are then automatically generated as per the schedule (refer to OP-15 Infrastructure Maintenance, Rehabilitation and Renewal).
- 3.3 Details regarding the results of the calibration and/or verification are recorded within each individual work order generated by the WMS, and in the facility logbook.
- 3.4 Calibration and maintenance activities are carried out in accordance with procedures specified in the manufacturer's manual, instructions specified in WMS or OCWA's calibration procedures.
- 3.5 Standards, reagents and/or chemicals that may be utilized during calibration and/or verification and/or maintenance activities are verified before use to ensure they are not expired. Any expired standards, reagents and/or chemicals are appropriately disposed of and are replaced with new standards, reagents and/or chemicals as applicable.
- 3.6 Any measurement device which does not meet its specified performance requirements during calibration and/or verification must be removed from service (if practical) until repaired, replaced or successfully calibrated. The failure must be reported to Operations Management and the ORO, as soon as possible so that immediate measures can be taken to ensure that drinking water quality has not been compromised by the malfunctioning device. Any actions taken as a result of the failure are recorded in the facility logbook and/or WMS work order. Operations Management or the PCT ensures that any notifications required by applicable legislation are completed and documented within the specified time period.





**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-17  
Rev Date: 2024-07-08  
Rev No: 1  
Pages: 2 of 2

**MEASUREMENT AND RECORDING EQUIPMENT  
CALIBRATION AND MAINTENANCE**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager


3.7 Calibration and maintenance records and maintenance/equipment manuals are maintained as per OP-05 Document and Records Control.

**4. Related Documents**

- Calibration/Maintenance Records
- Facility Logbook
- Maintenance/Equipment Manuals
- WMS Records
- OP-05 Document and Records Control
- OP-13 Essential Supplies and Services
- OP-15 Infrastructure Maintenance, Rehabilitation and Renewal

**5. Revision History**

<b>Date</b>	<b>Revision</b>	<b>Reason for Revision</b>
Mar. 18, 2022	0	Procedure issued
Jul. 8, 2024	1	Updated Step 3.2 to clarify SuperUser and 3.6 to change location of recording equipment failures. Removed watermark.

 Ontario Clean Water Agency	<b>OPERATIONAL PLAN</b> Cobalt Drinking Water System	QEMS Proc.: OP-18 Rev Date: 2024-07-08 Rev No: 2 Pages: 1 of 4
<b>EMERGENCY MANAGEMENT</b>		
Reviewed by: I. Bruneau, QEMS Representative	Approved by: B. Logan, Sr. Operations Manager	

## 1. Purpose

To describe the procedure for maintaining a state of emergency preparedness at the Cobalt WTP

## 2. Definitions

*Corporate Emergency Response Plan (ERP)* – a corporate-level emergency preparedness plan for responding to and supporting serious (Level 3) operations emergencies

*Facility Emergency Plan (FEP)* – a facility-level emergency preparedness plan for responding to and recovering from operations emergencies

*Operations Management* – refers to the Senior Operations Manager and/or Operations Manager that directly oversees a facility's operations

## 3. Procedure

3.1 The Facility Emergency Plan (FEP) is the corporate standard for emergency management at OCWA-operated facilities. The FEP supports the facility-level response to and recovery from Level 1, 2 and 3 events related to water and wastewater operations and directly links to the Corporate Emergency Response Plan (CERP) for management of Level 3 events that require corporate support. Operations Management is responsible for establishing a site-specific FEP that meets the corporate standard for these drinking water systems.

3.2 OCWA recognizes three levels of events:

**Level 1** is an event that can be handled entirely by plant staff and regular contractors. The event and the actions taken to resolve it (and to prevent a reoccurrence, if possible) are then included in regular reporting (both internally and externally). Examples may include response to an operational alarm, first aid incident, small on-site spill, or a process upset that can be easily brought under control.

**Level 2** is an event that is more serious and requires immediate notification of others (regulator, owner). Examples may include minor basement flooding, injury to staff that requires medical attention, or a spill that causes or is likely to cause localized, off-site adverse effects. If the event reaches this level, the instructions indicate the need to contact the Safety, Process and Compliance Manager and/or Regional Hub Manager.

**Level 3** is an actual or potential situation that will likely require significant additional resources and/or threatens continued operations. It may require corporate-level support including activation of the OCWA Action Group and opening of an Emergency Operations Centre (EOC) as described in the corporate ERP. Level 3 events usually



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-18  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 2 of 4

**EMERGENCY MANAGEMENT**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

involve intervention from outside organizations (client, emergency responders, Ministry of the Environment, Conservations and Parks, media, etc.). Examples may include:

- Disruption of service/inability to meet demand;
- Critical injury including loss of life;
- Breach of security that is a threat to public health;
- Intense media attention;
- Community emergency affecting water supply/treatment;
- Declared pandemic; or
- Catastrophic failure that could impact public health or the environment or cause significant property damage.

3.3 Potential emergency situations or service interruptions identified for the Cobalt Drinking Water System include:

- Unsafe Water
- Spill Response
- Critical Injury
- Critical Shortage of Staff
- Loss of Service
- Security Breach

3.4 The processes for responding to and recovering from each potential emergency situation/service disruption are documented within a contingency plan (CP). The CPs and related site specific environmental emergency procedures (EEPs) are contained within the FEP. To better support management and operational staff when dealing with emergency situations, the CPs are linked to related EEPs.

3.5 OCWA's training requirements related to the FEP are as follows:

Training Topic	Training Provider	Type of Training	Frequency	Required For
Establishing and maintaining a FEP that meets the corporate standard	Safety, Process and Compliance Manager and/or Corporate Compliance (as required)	On-the-Job Practical	Upon hire and when changes are made to the corporate standard*	PCTs (or others identified by the Operations Management)
Contents of the site-specific FEP	Facility Level (coordinated by QEMS Representative)	On-the-Job Practical	Upon hire and when changes to the FEP are made*	All operations personnel with responsibilities for responding to an emergency

\*Note: Changes to the corporate standard or site-specific FEP may only require the change to be communicated to Operations for implementation. Therefore, not all changes will require training.

3.6 At least one CP must be tested each calendar year and each CP must be reviewed at least once in a five-calendar year period. The reviews and tests are recorded on the FEP-01 Contingency Plan Review/Test Summary Form. This record includes the



Ontario Clean Water Agency

# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-18  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 3 of 4

## EMERGENCY MANAGEMENT

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

outcomes of the review/test, and identifies any opportunities for improvement and actions taken. A scheduled test of a CP may be regarded as a review of that particular CP as long as the outcomes are evaluated using the FEP-01 form. A CP-related response to an actual event may also be considered a review or a test. A review of the incident including lessons learned should be recorded on FEP-01 following the resolution of the actual event, along with any opportunities for improvement/actions identified.

- 3.7 Revisions to the CPs, EEPs and other FEP documents are made (as necessary) following a review, test, actual event or other significant change (e.g., changes in regulatory requirements, corporate policy or operational processes and/or equipment, etc.). Results of the emergency response testing and any opportunities for improvement/actions identified are considered during the Management Review (OP-20).
- 3.8 Roles and responsibilities for emergency management at OCWA-operated facilities are set out in the FEP. Specific roles and responsibilities related to a particular emergency situation or service interruption (including those of the Owner where applicable) are set out in the relevant site-specific CP. A general description of the respective responsibilities of the Owner and the operating authority in the event an emergency occurs is included in the service agreement with the Owner (as required by the *Safe Drinking Water Act*).
- 3.9 Where they exist, any relevant sections of the Municipal Emergency Response Plan (MERP) are included or referenced in the appendices section of the FEP. Measures specified in the MERP are incorporated into CPs where appropriate.
- 3.10 An emergency contact list in conjunction with the essential supplies and services list is contained within the FEP and is reviewed/updated at least once per calendar year. An emergency communications protocol is contained within the FEP. Specific notification requirements during emergency situations or service interruptions are set out in the individual CPs and in the ERP.

#### 4. Related Documents

- Corporate Emergency Response Plan
- Emergency Contact List/Essential Supplies & Services List (Contacts section of FEP)
- Facility Emergency Plan
- FEP-01 Contingency Plan Review/Test Summary Form
- Municipal Emergency Response Plan (as applicable)
- WMS
- OP-20 Management Review



Ontario Clean Water Agency

# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-18  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 4 of 4


## EMERGENCY MANAGEMENT

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

### 5. Revision History

Date	Revision	Reason for Revision
Mar. 18, 2022	0	Procedure issued
Oct. 11, 2023	1	Updated Ministry of the Environment and Climate Change to Ministry of the Environment, Conservation and Parks in step 3.2. Changed SOPs to EEPs to reflect the procedures in the FEP binder. Updated Step 3.4 to indicate the link between the CPs to the EEPs.
Jul. 8, 2024	2	Modified references to Emergency Response Plan to indicate it is now referred to as Corporate Emergency Response Plan (CERP). Updated Step 3.4 to indicate the link between the CPs to the EEPs. Removed watermark.

 Ontario Clean Water Agency	<b>OPERATIONAL PLAN</b> Cobalt Drinking Water System	QEMS Proc.: OP-19 Rev Date: 2024-07-08 Rev No: 2 Pages: 1 of 5
<b>INTERNAL QEMS AUDITS</b>		
Reviewed by: I. Bruneau, QEMS Representative		Approved by: B. Logan, Sr. Operations Manager

## 1. Purpose

To describe the procedure for conducting internal audits at the facility level that evaluate the conformance of OCWA's Quality & Environmental Management System (QEMS) to the requirements of the Drinking Water Quality Management Standard (DWQMS).

This procedure applies to Internal QEMS Audits conducted at the Cobalt Drinking Water System for the purpose of meeting the DWQMS requirements for internal audits.

Note: This procedure does not apply to internal compliance audits conducted in accordance with OCWA's Internal Audit Program.

## 2. Definitions

*Audit Team* – one or more Internal Auditors conducting an audit

*Internal Auditor* – an individual selected to conduct an Internal QEMS Audit

*Internal QEMS Audit* – a systematic and documented internal verification process that involves objectively obtaining and evaluating documents and processes to determine whether a quality management system conforms to the requirements of the DWQMS

*Lead Auditor* – Internal Auditor responsible for leading an Audit Team

*Non-conformance* – non-fulfillment of a DWQMS requirement

*Objective Evidence* – verifiable information, records or statements of facts. Audit evidence is typically based on interviews, examination of documents, observations of activities and conditions, reviewing results of measurements and tests or other means. Information gathered through interviews should be verified by acquiring supporting information from independent sources

*Opportunity for Improvement (OFI)* – an observation about the QEMS that may, in the opinion of the Internal Auditor, offer an opportunity to improve the effectiveness of the system or prevent future problems; implementation of an OFI is optional

## 3. Procedure

### 3.1 Audit Objectives, Scope and Criteria

3.1.1 In general, the objectives of an internal QEMS audit are:

- To evaluate conformance of the implemented QEMS to the requirements of the DWQMS;
- To identify non-conformances with the documented QEMS;
- To identify areas for improvement to enhance the QEMS; and



Ontario Clean Water Agency

## OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-19  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 2 of 5

### INTERNAL QEMS AUDITS

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

- To assess the effectiveness of the QEMS and assist in its continual improvement.

3.1.2 The scope of an internal QEMS audit includes activities and processes related to the QEMS as documented in the Operational Plan.

3.1.3 The criteria covered by an internal QEMS audit include:

- Drinking Water Quality Management Standard (DWQMS)
- Current Operational Plan
- QEMS-related documents and records

3.1.4 The audit scope and criteria may be customized as necessary to focus on a particular process/critical control point and/or any elements of the DWQMS which may warrant specific attention. The results of previous internal and external audits should also be considered.

### 3.2 Audit Frequency

3.2.1 Internal QEMS audits may be scheduled and conducted once every calendar year or may be separated into smaller audit sessions scheduled at various intervals throughout the calendar year. However, all elements of the DWQMS must be audited at least once every calendar year.

3.2.2 The QEMS Representative is responsible for maintaining the internal QEMS audit schedule. The audit schedule may be modified based on previous audit results.

### 3.3 Internal Auditor Qualifications

3.3.1 Internal QEMS audits shall only be conducted by persons approved by the QEMS Representative and having the following minimum qualifications:

- Internal auditor training or experience in conducting management system audits; and
- Familiarity with the DWQMS requirements.

3.3.2 Internal Auditors that do not meet the qualifications in s.3.3.1 may form part of the Audit Team for training purposes, but cannot act as Lead Auditor.

3.3.3 Internal Auditors must remain objective and, where practical, be independent of the areas/activities being audited. It may not be possible for internal auditors to be fully independent of the activity being audited, but every effort should be made to remove bias and encourage objectivity. Auditors should maintain objectivity throughout the audit process to ensure that the audit findings and conclusions are based only on the audit evidence. Objectivity can be demonstrated by obtaining sufficient appropriate evidence to provide a reasonable basis for the



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-19  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 3 of 5

## INTERNAL QEMS AUDITS

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

audit findings.

### 3.4 Audit Preparation

3.4.1 Together, the QEMS Representative and the Lead Auditor:

- Establish the audit objectives, scope and criteria;
- Confirm the audit logistics (locations, dates, expected time and duration of audit activities, any health and safety considerations, availability of key personnel, audit team assignments, etc.).

3.4.2 Each Internal Auditor is responsible for:

- Reviewing documentation to prepare for their audit assignments including:
  - the Operational Plan and related procedures;
  - results of previous internal and external QEMS audits;
  - the status and effectiveness of corrective and preventive actions implemented;
  - the results of the management review;
  - the status/consideration of OFIs identified in previous audits; and
  - other relevant documentation.
- Preparing work documents (e.g., checklists, forms, etc.) for reference purposes and for recording objective evidence collected during the audit

### 3.5 Conducting the Audit

3.5.1 Opening and closing meetings are not required, but may be conducted at the discretion of the QEMS Representative and the Lead Auditor taking into account expectations of Top Management.

3.5.2 The Audit Team gathers and records objective evidence by engaging in activities that may include conducting interviews with Operations Management and staff (in person, over the phone and/or through e-mail), observing operational activities and reviewing documents and records.

3.5.3 The Audit Team generates the audit findings by evaluating the objective evidence against the audit criteria (s. 3.1.3). In addition to indicating conformance or non-conformance, the audit findings may also lead to the identification of opportunities for improvement (OFIs). The Lead Auditor is responsible for resolving any differences of opinion among Audit Team members with respect to the audit findings and conclusions.

### 3.6 Reporting the Results

3.6.1 The Lead Auditor reviews the audit findings and conclusions with the QEMS Representative and Top Management. Other audit participants may also take part in this review as appropriate. This review may take place in person (e.g.,





# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-19  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 4 of 5

## INTERNAL QEMS AUDITS

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

during a closing meeting) or through other means (phone call, email, etc.). Any diverging opinions regarding the audit findings and conclusions should be discussed and, if possible, resolved. If not resolved, this should be noted by the Lead Auditor.

3.6.2 The Lead Auditor submits a written report and/or completed work documents to the QEMS Representative. The submitted documentation must identify (at a minimum):

- Audit objectives, scope and criteria;
- Audit Team member(s) and audit participants;
- Date(s) and location(s) where audit activities were conducted;
- Audit findings including:
  - Related objective evidence for each element;
  - Any non-conformance identified referencing the requirement that was not met; and
  - OFIs or other observations.
- Audit conclusions.

3.6.3 The QEMS Representative distributes the audit results to Top Management and others as appropriate.

3.6.4 The QEMS Representative ensures that results of internal QEMS audits are included as inputs to the Management Review as per OP-20 Management Review.

### 3.7 Corrective Actions and Opportunities for Improvement (OFIs)

3.7.1 Corrective actions are initiated when non-conformances are identified through internal QEMS audits and are documented and monitored as per OP-21 Continual Improvement.

3.7.2 OFIs are considered, and preventive actions initiated, documented and monitored as per OP-21 Continual Improvement.

### 3.8 Record-Keeping

3.8.1 Internal QEMS audit records are filed by the QEMS Representative and retained as per OP-05 Document and Records Control.

## 4. Related Documents

Internal Audit Records (checklists, forms, reports, etc.)  
QEMS – Summary of Findings Spreadsheet  
OP-05 Document and Records Control  
OP-20 Management Review



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-19  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 5 of 5

**INTERNAL QEMS AUDITS**

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

OP-21 Continual Improvement

**5. Revision History**

<b>Date</b>	<b>Revision #</b>	<b>Reason for Revision</b>
Sep. 14, 2022	0	Procedure issued
Oct. 11, 2023	1	Updated Step 3.1.1 to include the identification of areas for improvement to enhance the QEMS.
Jul. 8, 2024	2	Procedure updated to describe and document how objectivity is maintained when an internal auditor is not fully independent of the activity being audited with additions to s. 3.3.3. Removed watermark.



# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-20  
Rev Date: 2022-09-14  
Rev No: 0  
Pages: 1 of 3

## MANAGEMENT REVIEW

Reviewed by: R. Marshall, QEMS Representative

Approved by: Y. Rondeau, SPC Manager

### 1. Purpose

To describe the procedure for conducting a Management Review of the Quality & Environmental Management System (QEMS) at the facility level.

### 2. Definitions

*Management Review* – a formal (documented) meeting conducted at least once every calendar year by Top Management to evaluate the continuing suitability, adequacy and effectiveness of OCWA's Quality & Environmental Management System (QEMS)

*Operations Management* – refers to the Senior Operations Manager and/or Operations Manager that directly oversees a facility's operations

*Top Management* – a person, persons or group of people at the highest management level within an operating authority that makes decisions respecting the QMS and recommendations to the owner respecting the subject system or subject systems.

OCWA has defined Top Management for the Cobalt Drinking Water System as:

- Operations Management – Temiskaming Shores Cluster
- Regional Hub Manager – Northeastern Ontario Regional Hub
- Safety, Process & Compliance (SPC) Manager – Northeastern Ontario Regional Hub

### 3. Procedure

3.1 Top Management ensures that a Management Review is conducted at least once every calendar year.

Management Reviews for more than one drinking water system may be conducted at the same meeting provided the systems belong to the same owner and the considerations listed in section 3.4 below are taken into account for each individual system and documented in the Management Review meeting minutes.

3.2 At a minimum, the QEMS Representative, at least one member of Top Management and at least one facility operator must attend the Management Review meeting. Other members of Top Management may participate though their attendance is optional.

3.3 Other staff may be invited to attend the Management Review meeting or to assist with presenting information or in reviewing the information presented, where they offer additional expertise regarding the subject matter.

3.4 The standing agenda for Management Review meetings is as follows:

- a) Incidents of regulatory non-compliance;
- b) Incidents of adverse drinking water tests;
- c) Deviations from critical control limits and response actions;



**OPERATIONAL PLAN**  
Cobalt Drinking Water System

QEMS Proc.: OP-20  
Rev Date: 2022-09-14  
Rev No: 0  
Pages: 2 of 3

**MANAGEMENT REVIEW**

Reviewed by: R. Marshall, QEMS Representative | Approved by: Y. Rondeau, SPC Manager

- d) The effectiveness of the risk assessment process;
- e) Internal and third-party audit results (including any preventive actions implemented to address Opportunities for Improvement (OFI) or rationale as to why OFIs were not implemented);
- f) Results of emergency response testing (including any OFIs identified);
- g) Operational performance;
- h) Raw water supply and drinking water quality trends;
- i) Follow-up on action items from previous Management Reviews;
- j) The status of management action items identified between reviews;
- k) Changes that could affect the QEMS;
- l) Consumer feedback;
- m) The resources needed to maintain the QEMS;
- n) The results of the infrastructure review;
- o) Operational Plan currency, content and updates;
- p) Staff suggestions; and
- q) Consideration of applicable Best Management Practices (BMPs).

3.5 In relation to standing agenda item q), applicable BMPs, if any, to address drinking water system risks discussed during other agenda items, are identified and documented in the Management Review minutes. Review and possible adoption of applicable BMPs are revisited during subsequent Management Reviews and are incorporated into preventive and/or corrective actions as per OP-21 as appropriate.

3.6 The SPC Manager coordinates the Management Review and distributes the agenda with identified responsibilities to participants in advance of the Management Review meeting along with any related reference materials.

3.7 The Management Review participants review the data presented and make recommendations and/or initiate action to address identified deficiencies as appropriate as per OP-21.

3.8 The QEMS Representative ensures that minutes of and actions resulting from the Management Review meeting are prepared and distributed to the appropriate OCWA Top Management, personnel and the Owner.

3.9 The QEMS Representative monitors the progress and documents the completion of actions resulting from the Management Review.

#### **4. Related Documents**

Management Review Reference Materials  
Minutes and actions resulting from the Management Review  
OP-21 Continual Improvement



**OPERATIONAL PLAN**  
Cobalt Drinking Water System


QEMS Proc.: OP-20  
Rev Date: 2022-09-14  
Rev No: 0  
Pages: 3 of 3

**MANAGEMENT REVIEW**

Reviewed by: R. Marshall, QEMS Representative | Approved by: Y. Rondeau, SPC Manager

**5. Revision History**

Date	Revision #	Reason for Revision
Sep. 14, 2022	0	Procedure issued

	<p align="center"><b>OPERATIONAL PLAN</b> Cobalt Drinking Water System</p>	<p>QEMS Proc.: OP-21 Rev Date: 2024-07-08 Rev No: 2 Pages: 1 of 3</p>
<b>CONTINUAL IMPROVEMENT</b>		
Reviewed by: I. Bruneau, QEMS Representative	Approved by: B. Logan, Sr. Operations Manager	

## 1. Purpose

To describe the procedure for tracking and measuring continual improvement of the Quality & Environmental Management System (QEMS) for the Cobalt Drinking Water System.

## 2. Definitions

*Continual Improvement* - recurring activity to enhance performance (ISO 14001:2014)

*Corrective Action* – action to eliminate the cause of detected nonconformity of the QMS with the requirements of the DWQMS or other undesirable situation

*Non-conformance* – the non-fulfilment of a DWQMS requirement

*Preventive Action* – action to prevent the occurrence of nonconformity of the QMS with the requirements of the DWQMS or other undesirable situation

## 3. Procedure

3.1 OCWA strives to continually improve the effectiveness of its QEMS for this drinking water system(s) through the identification and implementation of corrective/preventive actions and, as appropriate, through review and consideration of applicable Best Management Practices (BMPs).

### 3.2 Corrective Actions

3.2.1 Non-conformances may be identified through an internal or external QEMS audit(s) conducted for this drinking water system. They may also be identified as a result of other events such as:

- an incident/emergency;
- community/Owner complaint;
- other reviews; and
- operational checks, inspections or audits.

3.2.2 The QEMS Representative (in consultation with Operations Management and/or the SPC Manager) investigates the need for a corrective action to eliminate the root cause(s) so as to prevent the non-conformance from recurring. The investigation may also include input from the operators and other stakeholders and the consideration of BMPs as appropriate. A root cause analysis is performed for any non-conformance and is documented in the Summary of Findings" spreadsheet.



Ontario Clean Water Agency

## OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-21  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 2 of 3

### CONTINUAL IMPROVEMENT

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

3.2.3 The QEMS Representative determines the corrective action needed based on this consultation. The Operations Management (or designate) assigns responsibility and a target date for resolution.

3.2.4 The QEMS Representative ensures corrective actions are documented using the QEMS - Summary of Findings spreadsheet. The QEMS Representative monitors the progress of corrective action(s) and provides status updates to Top Management.

3.2.5 The implementation and effectiveness of corrective actions are verified during subsequent internal QEMS audits and are considered during the Management Review. If there is evidence that the action taken was not effective, the Operations Management (or designate) initiates further corrective action and assigns resources as appropriate until the non-conformance is fully resolved.

### 3.3 Preventive Actions

3.3.1 Potential preventive actions may be identified through an internal or external QEMS audit as Opportunities For Improvement (OFIs), during the Management Review or through other means such as:

- staff/Owner suggestions;
- regulator observations;
- evaluation of incidents/emergency response/tests;
- the analysis of facility/Regional Hub or OCWA-wide data/trends;
- non-conformances identified at other drinking water systems; or
- a result of considering a BMP.

3.3.2 The QEMS Representative (in consultation with Operations Management and/or the SPC Manager) considers whether a preventive action is necessary. The review may also include input from the operators and other stakeholders and the consideration of BMPs as appropriate.

3.3.3 If it is decided that a preventive action is necessary, the QEMS Representative determines the action to be taken based on this consultation and the Operations Management (or designate) assigns responsibility and a target date for implementation.

3.3.4 The implementation of preventive actions are tracked by the QEMS Representative using the QEMS - Summary of Findings spreadsheet.

3.3.5 The implementation and effectiveness of preventive actions are verified during subsequent internal QEMS audits and are considered during the Management Review. If there is evidence that the action taken was not effective, the Operations Management (or designate) may consider further preventive actions and assigns resources as appropriate.



Ontario Clean Water Agency

# OPERATIONAL PLAN

Cobalt Drinking Water System

QEMS Proc.: OP-21  
Rev Date: 2024-07-08  
Rev No: 2  
Pages: 3 of 3

## CONTINUAL IMPROVEMENT

Reviewed by: I. Bruneau, QEMS Representative

Approved by: B. Logan, Sr. Operations Manager

3.4 The QEMS Rep. and Operations Management monitor corrective/preventive actions on an ongoing basis and review the status and effectiveness of the actions during subsequent Management Review meetings.

### 3.5 Best Management Practices (BMPs)

3.5.1 The QEMS Representative and/or Operations Management in consultation with the SPC Manager will review and consider applicable internal and/or external BMPs identified by internal and/or external sources as part of the Management Review (OP-20) and in the corrective and preventive action processes described above.

3.5.2 BMPs may include, but are not limited to:

- Facility/Regional Hub practices developed and adopted as a result of changes to legislative or regulatory requirements, trends from audit findings or drinking water system performance trends;
- OCWA-wide BMPs/guidance or recommended actions;
- Drinking water industry based standards/BMPs or recommendations; or
- Those published by the Ministry.

3.5.3 At a minimum, applicable BMPs must be reviewed and considered once every 36 months.

## 4. Related Documents

Internal Audit Records  
QEMS - Summary of Findings Spreadsheet  
OP-05 Document and Records Control  
OP-20 Management Review

## 5. Revision History

Date	Revision #	Reason for Revision
Sep 15, 2022	0	Procedure issued
Oct. 11, 2023	1	Updated Ministry of the Environment and Climate Change to Ministry of the Environment, Conservation and Parks in step 3.5.2.
Jun. 8, 2024	2	Updated Ministry of the Environment, Conservation and Parks to Ministry in step 3.5.2.



**Schedule C – Director’s Directions for Operational Plans  
(Subject System Description Form)  
Municipal Residential Drinking Water System**

Fields marked with an asterisk (\*) are mandatory.

Owner of Municipal Residential Drinking Water System \*

[The Corporation of the Town of Cobalt](#)

**Subject Systems**

Name of Drinking Water System (DWS) *	Licence Number *	Name of Operating Subsystems (if applicable)	Name of Operating Authority *	DWS Number(s) *
1. Cobalt Drinking Water System	206-101		Ontario Clean Water Agency	220000362

[Add item \(+\)](#)

**Contact Information for Questions Regarding the Operational Plan** [i](#)

**Primary Contact**

Last Name *	First Name *	Middle Initial
<a href="#">Logan</a>	<a href="#">Bryce</a>	
Title *	Telephone Number *	Email Address *
<a href="#">Operations Manager</a>	<a href="#">705-648-4082</a> ext. <input type="text"/>	<a href="#">BLogan@ocwa.com</a>

**Secondary Contact**

Last Name	First Name	Middle Initial
<a href="#">Bruneau</a>	<a href="#">Ilona</a>	
Title	Telephone Number	Email Address
<a href="#">Process &amp; Compliance Technician</a>	<a href="#">705-648-4314</a> ext. <input type="text"/>	<a href="#">IBruneau@ocwa.com</a>

[Save Form](#)

[Print Completed Form](#)

[Clear Form](#)